

Corporate Identification Number (CIN): L24220MH1945PLC004598

For Shares related queries, email to investor.relations@asianpaints.com

For Consumer queries/complaints/Dealership enquiries email to customercare@asianpaints.com

For HR related queries, email to careers@asianpaints.com

For Media related queries, email to proffice@asianpaints.com



Asian Paints Limited

Plot No. 2602 to 2607 & 2609 to 2614, 2701/A + 2701/B, 2702, 2703

GIDC Industrial Estate, Ankleshwar - 393 002.

Tel: (02646) 678000 | www.asianpaints.com

APL/PAINTS/MoEF/HY/JUN-26

Date: 01.06.2026

To,
Deputy Director General of Forests (C),
Ministry of Environment, Forest and Climate Change,
Integrated Regional Office, Gandhi Nagar A wing- 407 & 409,
Aranya Bhawan, Near CH-3 Circle,
Sector-10A, Gandhinagar-382010
E mail - iro.gandhingr-mefcc@gov.in

Subject: Submission of Half Yearly Environmental compliance status report of Asian Paints Limited, based out of GIDC, Ankleshwar - 393002

Dear Sir,

Enclosed herewith attached is the half yearly EC compliance report for our plant located at Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B, GIDC Ind Estate, Ankleshwar 393002.

The status of Half yearly Compliance against the granted EC, Ref no SEIAA/GUJ/EC/5(h)/597/2018 is attached herewith.

We trust you will find the above in order.

Thanking you.
Yours faithfully,

For ASIAN PAINTS LIMITED

**Authorized Signatory,
ASIAN PAINTS LIMITED
ANKLESHWAR PLANT**

Encl.: As Above

CC.: - Regional Office, GPCB, Ankleshwar

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

Environment Clearance No.: SEIAA/GUJ/EC/5(h)/597/2018					
Sr. No.	Product	Existing (TPA / KLPA)	Additional quantity (TPA/ KLPA)	Total after expansion (TPA / KLPA)	Remark
1	Phallic Anhydride	29796 TPA	-29796 TPA	0	Complied, Not applicable.
2	Light and Heavy ends of phthalic Anhydride	360 TPA	-360 TPA	0	Complied, Not applicable.
3	Maleic Acid Solution	4860 TPA	-4860 TPA	0	Complied, Not applicable.
4	Paints	130000 KLPA	+170000 KLPA	300000 KLPA	Complied The existing CC&A AWH -151881 quantity for paint production is 2,50,000 KLPA. The total Paint production for the period Oct'25 - Mar'26 was 45401 KL. The month-wise Production figures are attached as Annexure A.
5	Resins and Emulsion (TSR)	32000 TPA	+53000 TPA	85000 TPA	Complied The existing CC&A AWH -151881 quantity for resin & emulsion (TSR) production is 85,000 TPA. The total Synthetic Resins and Emulsion production for the period Oct'25 - Mar'26 was 12348 MT. The month-wise Production figures are attached as Annexure A.
A	Conditions				
A.1	Specific conditions				
1	Unit Shall Surrender the Membership certificate of M/s NCTL and ensure that there shall be no wastewater discharge outside the premises				Noted, Provision to discharge effluent has been removed from CC&A and unit is complete ZLD. Connection to underground drainage has been disconnected and disconnection certificate obtained from Notified Area Authority. A letter submitted to M/s NCTL to surrender the membership certificate.
2	Complete Zero Liquid Discharge (ZLD) shall be maintained all the time				Complied, Annexure B has been attached herewith as ZLD certificate received from GIDC. The proposed Unit shall remain to be ZLD post commissioning of Plant. Annexure C has been attached herewith as existing effluent treatment plant along with ZLD facility.
3	The spent solvent from production processes shall be recovered by in-house distillation in such a manner that recovery is maximum and recovered solvent shall be reused in the process within premises				Complied, The spent solvent from process is recovered through in-house distillation and recovered solvent is further reused in the process within premises.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

4	Unit shall comply all the conditions & recommendations mentioned in the guidelines for the management of the spent solvents published by GPCB in letter and spirit.	Complied, Unit is complying with the guidelines for the management of the spent solvents published by GPCB.
5	Leak Detection and Repair (LDAR) program shall be prepared and implemented as per the CPCB guidelines	Noted & complied, LDAR Program for arresting leakages has been prepared and implemented.
6	Incinerator shall be as per the CPCB Guidelines & proper logbook shall be maintained	Complied, Incinerator is as per CPCB Guidelines & logbook is maintained. For the above span the incinerator was operated for 82 Hrs. complying with legal requirements.
7	Waste generated due to demolition of buildings and other civil structures shall be segregated properly and the Construction and Demolition Waste Management Rules, 2016 shall be followed in letter and spirit	Complied, all waste generated due to demolition activity is segregated properly. Metal and wooden waste are disposed through recyclers, and civil debris is reused in the inhouse for back filling.
A.2 WATER		
8	Total water requirement for the project shall not exceed 1300 KL/Day. Unit shall reuse 299.4 KLD of treated water (RO permeate 270 KLD and MEE condensate 29.4 KLD for industrial purpose. Hence, freshwater requirement shall not exceed 1000.6 KL/Day and it shall be met through GIDC water supply only. Prior permission from the concerned authority shall be obtained for withdrawal of water.	Complied, Water consumption of plant will remain within the limit mentioned. During the period of Oct'25 - Mar'26, the maximum freshwater usage was 831 KL/day and average freshwater usage was 343 KL/day & average treated water reused was 13 KL/day.
9	The water meter shall be installed and records of daily and monthly water consumption shall be maintained	Complied, Water meters are provided for measuring and recording quantity of the water consumed at various locations in the plant. Few snapshots of the flow meters are attached as Annexure D.
10	No ground water shall be tapped for the project requirements	Complied, No ground water was tapped for the project requirement.
11	All efforts shall be made to optimize water consumption by exploring Best Available Technology (BAT). The unit shall continuously strive to reduce, recycle and reuse the treated effluent	Noted, All efforts are made to optimize water consumption by exploring Best Available Technology (BAT). Currently, unit reuses the treated effluent in operations and will continue to do so.
12	Industrial waste water generation shall not exceed 138 KL/day	Complied, During the period of Oct'25 - Mar'26, the maximum wastewater generated from Industrial purpose was 35.78 KL/day and the average Industrial wastewater generated was 13.68 KL/day. Annexure E has been attached herewith for reference.
13	Entire quantity of effluent stream shall be treated in proposed ETP (Cap. 300 KL/day) comprises of primary, secondary and tertiary treatment followed by RO system.	Complied, Wastewater generated is being treated in ETP which comprises of primary, secondary and tertiary treatment followed by RO and MEE system.
14	RO reject stream (30 KLD) shall be subjected to in house MEE - Multiple Effective Evaporator.	Complied, RO reject is being treated in MEE - Multiple Effective Evaporator.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

15	RO permeate 270 KLD and MEE condensate 29.4 KLD shall be reused for utilize for industrial purpose.						Complied, RO permeate and MEE condensate are being reused for industrial purposes. During the period of Oct'25 - Mar'26, average 13 KL/day treated water was reused for industrial purpose.
16	Domestic waste water 162 KLD/Day shall be treated along with industrial effluent in ETP and treated waste water shall be reused for gardening and toilet flushing within premises.						Complied, During the period of Oct'25 - Mar'26, the maximum domestic waste water generated was 50 KL/day and the average domestic waste water generated was 28 KL/day. Annexure E has been attached herewith. Domestic effluent is being treated in ETP along with industrial effluent and reused for gardening / other purposes.
17	Unit shall provide adequate ETP system along with RO & MEE including stripper and ATFD to achieve Zero Liquid Discharge [ZLD].						Noted, Adequate ETP system along with RO & MEE including ATFD to achieve Zero Liquid Discharge (ZLD) has been maintained. Annexure C has been attached herewith.
18	Unit shall provide buffer water storage tank of adequate capacity for storage of treated waste water during rainy days.						Complied, We are having storage tank of 380 KI of effluent with an impervious acid proof brick lining. The snapshot of the same is attached as Annexure F.
19	The unit shall provide metering facility at the inlet of the ETP & reuse system and maintain records for the same.						Complied, Flowmeters has been provided at the inlet of ETP, RO & MEE treated water.
20	Proper logbooks of ETP, chemical consumption, quantities and qualities of effluent reuse, power consumption etc. shall be maintained and shall be furnished to the GPCB from time to time.						Complied, The logbook of ETP, quantities and qualities of effluent reuse, power consumption etc. is being maintained and furnished to the GPCB.
21	The unit shall join and participate financially and technically for any common environmental facility / infrastructure as and when the same is taken up either by the GIDC or GPCB or any such authority created for this purpose by the Govt. / GIDC						Noted, We will evaluate and consider the need, to join and participate for any common environmental facility / infrastructure as and when the same is taken up either by the GIDC or GPCB.
A.3 AIR							
22	Unit shall not exceed quantity of fuel as mentioned in table as under						
Sr. No.	Stack attached to	Capacity	Stack Height (m)	Type of fuel used	Fuel consumption Kg/hr.)	APCM	Complied, In the plant, stack height & fuel consumption are as per the limit mentioned in the existing CC&A AWH - 151881.
1	Boiler -1	3 MT/Hr.	33.5	NG	78	Adequate Stack height	
2	Boiler - 2	6 MT/Hr.	33.5	NG	156		
3	DG Set - 1	8 MW each	30	HSD	131	Adequate Stack Height	
4	DG Set - 2		30	HSD	131		
5	DG Set - 3		30	HSD	131		
6	DG Set - 4		30	HSD	131		
7	DG Set - 5		30	HSD	131		
8	DG Set - 6		30	HSD	131		

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

9	DG Set - 7		30	HSD	131		Annexure G has been attached herewith for the stack emission monitoring summary report for the period of Oct'25 - Mar'26 along with the sample report for the month Jan'26.
10	DG Set - 8		30	HSD	131		
11	Incinerator (APCM with 95 % efficiency)	2 MTPD	30.5	NG	29	Adequate Stack Height and packed bed alkali scrubber	Adequate Stack Height
12	Thermic Heater - 1	2 Lakh Kcal/hr.	36	NG	120		
13	Thermic Heater - 2	2 Lakh Kcal/hr.	36	NG	120		
14	Thermic Heater - 3	2 Lakh Kcal/hr.	36	NG	120		
15	Thermic Heater - 4	2 Lakh Kcal/hr.	36	NG	120		
16	Thermic Heater - 5	2 Lakh Kcal/hr.	36	NG	120		
17	Thermic Heater - 6	2 Lakh Kcal/hr.	36	NG	120		
23	Unit shall provide adequate stack height / APCM as mentioned in the above table.						Complied, stacks height in the plant is complying to the existing CC&A AWH - 151881. For all additional equipment as part of the expanded capacity, adequate stack height / APCM as mentioned in the above table shall be ensured.
24	Acoustic enclosure shall be provided to the DG sets to mitigate the noise pollution and shall conform to the EPA Rules for air and noise emission standards.						Noted & complied, Acoustic enclosures are provided in the DGs to mitigate the noise pollution and shall conform to the EPA Rules for air and noise emission standards.
25	Stack/Vents of adequate height shall be provided as per the prevailing norms for flue gas emission/Process gas emission						Complied, For all equipment stack/vents of adequate height shall be provided as per the prevailing norms for flue gas emission /process gas emission.
26	There shall be no process gaseous emission from the proposed activities						Noted, All necessary equipment / infrastructure provisions are made.
27	Flue gas emission & Process gas emission (If any) shall conform to the standards prescribed by the GPCB/CPCB/MoEF & CC. At no time, emission level should go beyond the stipulated standards.						Complied, Currently, we are conforming to all the standards of emissions. Annexure G has been attached herewith for the stack emission monitoring summary report for the period of Oct'25 - Mar'26 along with the sample report for the month Jan'26.
28	All the reactors / vessels used in the manufacturing process shall be closed to reduce the fugitive emission						Complied, All the reactors/vessels used in the manufacturing process are closed to reduce the fugitive emission.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

29	Measures shall be taken to reduce the process vapors emissions as far as possible. Use of toxic solvents shall be minimum. All venting equipment shall have vapor recovery system. The fugitive emission in the work zone environment shall be monitored. The emission shall conform to the standards prescribed by the concerned authorities from time to time (e.g. Directors of Industrial Safety & Health). Following indicative guidelines shall also be followed to reduce the fugitive emission.	Noted, All possible measures are taken to reduce the process vapors emissions. Use of toxic solvents is minimized, and venting equipment has vapor recovery system. The fugitive emission in the work zone environment shall be monitored and shall conform to the standard prescribed by the concerned authorities from time to time.
	1. Internal roads shall be either concreted or asphalted or paved properly to reduce the fugitive emission during vehicular movement	Noted, All the internal roads are of concrete and paved properly to reduce the fugitive emission during vehicular movement.
	2. Air borne dust shall be controlled with water sprinklers at suitable locations in the plant	Noted, Adequate measures are being provided to control the air borne dust especially during the construction phase of the project.
	3. A green belt shall be developed all around the plant boundary and also along the roads to mitigate fugitive & transport dust emission	Noted, Adequate plantation is already established all along the periphery of the premises.
30	Regular monitoring of Volatile Organic Compounds (VOCs) shall be carried out in the work zone area and ambient air.	Complied, VOCs are being monitored regularly by the MoEF approved lab in the work zone and ambient air. Report is attached as Annexure H.
31	For control of fugitive emission, VOCs, following steps shall be followed	Complied, For control of fugitive emission, closed handling & charging systems are provided for major chemicals and mechanical seals are also provided in pumps to prevent leakages.
	1. Closed handling and charging system shall be provided for major chemicals	
	2. Pumps shall be provided with mechanical seals to prevent leakages	
32	Regular monitoring of ground level concentration of PM10, PM2.5, SO2, NOx and VOC shall be carried out in the impact zone and its records shall be maintained. Ambient air quality levels shall not exceed the standards stipulated by the GPCB. If at any stage these levels are found to exceed the prescribed limits, necessary additional control measures shall be taken immediately. The location of the stations and frequency of monitoring shall be decided in consultation with the GPCB	Complied, Ambient Air Quality Monitoring (AAQM) is being adhered to the requirements. Annexure I has been attached herewith in the form of sample AAQM monitoring report for the month of Oct'25.
A.4	SOLID / HAZARDOUS WASTES	
33	The company shall strictly comply with the rules and regulations with regards to handling and disposal of Hazardous waste in accordance with the Hazardous and Other Wastes (Management and Transboundary Movement) Rules 2016, as may be amended from time to time. Authorization of the GPCB shall be obtained for collection / treatment / storage / disposal of hazardous wastes.	Complied, Plant complies with the rules and regulations with regards to handling and disposal of Hazardous waste in accordance with the hazardous and Other Wastes (Management and Transboundary Movement) Rules 2016.
34	Hazardous wastes shall be dried, packed and stored in separate designated hazardous waste storage facility with pucca bottom and leachate collection facility, before its disposal	Complied, Hazardous waste is dried, packed and stored in separate designated hazardous waste storage facility with pucca bottom and leachate collection facility, before its disposal in the plant.
35	The unit shall obtain necessary permission from the nearby TSDF site and CHWIF	Complied, Unit has TSDF membership and its certificate has been attached as Annexure J.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

36	Oil contaminated with waste water & sludge, Sludge and filters contaminated with oil, Contaminated aromatic, aliphatic or naphthenic solvents, may or may not be fit for reuse, Distillation Residues, Process waste (landfill incinerable), Waste /residues, Waste/residues such as filter aids, Chemical containing residue arising from denomination, Discarded containers/barrels/liners contaminates with hazardous wastes/chemical (linear) incinerable, Spent Ion Exchange Resin containing toxic metals and Oil and Grease skimming residue shall sent to in-house Incinerator or sent to authorized co-processors.	Complied, All categories of waste mentioned are being disposed of through authorized co-processor / landfill, as per CC&A AWH -151881.
37	Spent Carbon shall be return back to supplier for regeneration or sent to in-house Incinerator or sent to authorized co-processors	Noted, Spent Carbon, if generated, shall be returned back to supplier for regeneration or sent to in-house Incinerator or sent to authorized co-processors.
38	Lead Acid Batteries shall be return back to supplier or sent to authorized recyclers as per the Battery Rules 2016	Complied, Lead Acid Batteries are sent to authorized recyclers as per the Battery Rules 2016 & amendments thereafter.
39	Management of Debris and construction waste, Paper waste, Plastic waste, Metal waste, wooden waste, Kitchen waste & Miscellaneous waste shall be as per the provisions of Solid Waste Management Rules, 2016, e-Waste (Management) Rules, 2016, the Construction and Demolition Waste Management Rules, 2016 and the Plastics Waste Management Rules, 2016	Noted, During and post completion of proposed project in the amalgamated plot, management of debris and construction waste, paper waste, plastic waste, metal waste, wooden waste, kitchen waste & miscellaneous waste shall be as per the provisions of Solid Waste management rules, 2016, e waste (Management) Rules, 2016, the Construction and Demolition Waste Management Rules, 2016 and the Plastic Waste Management Rules, 2016.
40	ETP waste, Discarded Asbestos sheet, Flue gas cleaning residue, Ash from incineration of hazardous waste, shall be disposed off at the nearby common TSDF	Complied, ETP waste, i.e. chemical sludge from wastewater treatment plant is being sent to authorized co-processor and TSDF for landfilling. Discarded Asbestos sheet, Flue gas cleaning residue, Ash from incineration of hazardous waste, are disposed of at the nearby common TSDF in the existing plant. Annexure K has been attached herewith in the form of manifest copies for the Chemical sludge disposal done.
41	Discarded barrels/containers/bags/liners shall be either reused or returned back to suppliers or sold only to the actual users authorized by the SPCB	Complied, Discarded barrels / containers / bags / liners are decontaminated, approved by AEPS and sold as Non-Hazardous waste. Haz. Bags / Liners are sent for landfill / co-processing. The same practice shall be continued as per CCA.
42	Used oil shall be sold only to the actual users authorized by the SPCB	Complied, Used oil is sold only to recyclers authorized by the GPCB.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

43	Trucks/Tankers used for transportation of hazardous waste shall be in accordance with the provisions under the Motor Vehicle Act, 1988, and rules made there under.	Complied, Trucks / tankers used for transportation of hazardous waste are in accordance with the provisions under the Motor Vehicle Act, 1988, and rules made there under.
44	The design of the Trucks/tankers shall be such that there is no spillage during transportation	Noted, The trucks used for transportation of hazardous waste are registered for Haz Waste transportation and designed such that there is no spillage. Same shall be maintained.
45	All possible efforts shall be made for Co-Processing of the Hazardous waste prior to disposal into TSDF/CHWIF	Complied, Waste, which is approved by GPCB for coprocessing, is primarily disposed off through co-processing/Pre-processing method. Annexure L has been attached herewith for the period of Oct'25 - Mar'26. Total 105.86 MT hazardous waste was disposed through coprocessing at cement site/Pre-processing.
46	Management of fly ash (If any) shall be as per the Fly ash Notification 2009 & its amendment time to time and it shall be ensured that there is 100% utilization of fly ash to be generated from the unit	Noted, There is no fly ash generation in the plant.
A.5	SAFETY	
47	The occupier/manager shall strictly comply the provisions under the Factories Act 1948 and the Gujarat Factories Rules 1963	Noted, Applicable provisions under the Factories Act 1948 and the Gujarat Factories Rules 1963 is complied at the plant.
48	The project authorities shall strictly comply with the provisions made in Manufacture, Storage and Import of Hazardous Chemicals Rules (MSIHC) 1989, as amended time to time and the Public Liability Insurance Act for handling of hazardous chemicals etc. Necessary approvals from the Chief Controller of Explosives and concerned Govt. Authorities shall be obtained before commissioning of the project. Requisite On-site and Off-site Disaster Management Plans have to be prepared and implemented.	Complied, We are complying with the provisions of the MSIHC rules in terms of the quantities, Storage and Usage of Hazardous chemicals in the plant. Onsite Emergency Plan is available and will be updated from time to time. Annexure M has been attached herewith for the compliance report for the period of Oct'25 - Mar'26.
49	First Aid Box shall be made readily available in adequate quantity at all the times	Noted, Adequate number of first aid boxes are available in plant.
50	Main entry and exit shall be separate and clearly marked in the facility.	Noted, The plant has 5 gates for entry and exit & marked clearly.
51	Sufficient peripheral open passage shall be kept in the margin area for free movement of fire tender/ emergency vehicle around the premises	Noted, The plant has sufficient peripheral open passage kept in the margin area for free movement of fire tender/ emergency vehicle around the premises.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

52	Storage of flammable chemicals shall be sufficiently away from the production area	Noted & complied, The plant has storage of flammable chemicals sufficiently away from the production area.
53	Sufficient number of fire extinguishers shall be provided near the plant and storage area	Noted & complied, The plant has enough fire extinguishers and are placed near plant and storage area. Annexure N has been attached herewith in the form of list of fire extinguishers available at site.
54	All necessary precautionary measures shall be taken to avoid any kind of accident during storage and handling of toxic / hazardous chemicals	Noted, All necessary precautions are taken to avoid any kind of accident during storage and handling of toxic / hazardous chemicals.
55	All the toxic/hazardous chemicals shall be stored in optimum quantity and all necessary permissions in this regard shall be obtained before commencing the expansion activities	Noted, The premises has toxic / hazardous chemicals stored in optimum quantity and all necessary permissions in this regard are obtained.
56	The project management shall ensure to comply with all the environment protection measures, risk mitigation measures and safeguards mentioned in the Risk Assessment report.	Noted, All the environment protection measures, risk mitigation measures and safeguards mentioned in the Risk Assessment Report are being complied.
57	Flame proof electrical fittings shall be provided in flame proof zones or wherever applicable in Plant premises	Noted & complied, Flame proof electrical fittings are available in flame proof zones or wherever applicable in Plant premises in existing plant.
58	Storage of hazardous chemicals shall be minimized and it shall be in multiple small capacity tanks / containers instead of one single large capacity tank / containers	Noted & complied, Unit is storing only required quantity of hazardous chemicals and it is stored as per guidelines and necessary licenses.
59	All the storage tanks shall be fitted with appropriate controls to avoid any leakages. Bund/dyke walls shall be provided for storage tanks for Hazardous Chemicals	Noted & complied, The storage tanks are fitted with appropriate controls to avoid leakages. Bund/dyke walls are also provided for storage tanks for Hazardous Chemicals.
60	Handling and charging of the Major chemicals shall be done in closed manner by pumping or by vacuum transfer so that minimal human exposure occurs	Noted & complied, This aspect of closed loop handling is considered and implemented with an endeavor to minimize human exposure.
61	Tie up shall be done with nearby health care unit / doctor for seeking immediate medical attention in the case of emergency	Noted & complied, The plant has a Health center at Plant with doctor and male nurse. This will continue to serve the purpose. In addition to this, plant has tied up with Jayaben Modi hospital, Ankleshwar.
62	Personal Protective Equipment's (PPEs) shall be provided to workers and its usage shall be ensured and supervised.	Noted & complied, Job specific PPE's are provided in the plant and its usage is monitored regularly.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

63	First Aid Box and required Antidotes for the chemicals used in the unit shall be made readily available in adequate quantity.	Noted & complied, Adequate number of first aid boxes with applicable antidotes are available in the Plant.
64	Training shall be imparted to all the workers on safety and health aspects of chemicals handling.	Noted & complied, This is being complied with and records of training are maintained.
65	Occupational health surveillance of the workers shall be done and its records shall be maintained. Pre-employment and periodical medical examination for all the workers shall be undertaken as per the Factories Act & Rules	Complied, Occupational health surveillance of the workers is carried out once every six months and its records are maintained. Pre-employment and periodical medical examinations for all the workers are also undertaken as per the Factories Act & Rules. Annexure O has been attached herewith in the form of one of the sample medical report conducted in the month of Dec'25.
66	Transportation of hazardous chemicals shall be done as per the provisions of the Motor Vehicle Act & Rules	Noted & complied, Transportation of hazardous chemical is being done as per the provisions of the Motor Vehicle Act & Rules and will continue to be done.
67	The company shall implement all preventive and mitigation measures suggested in the Risk Assessment Report	Noted & complied, Risk assessment is carried out in plant and mitigation measures are undertaken.
68	Necessary permissions from various statutory authorities like PESO, Factory Inspectorate and others shall be obtained prior to commissioning of the project	Complied, Prior to commissioning of the project, necessary permissions from various statutory authorities like PESO, Factory Inspectorate and others is obtained.
A.6	Noise	
69	The overall noise level in and around the plant area shall be kept well within the standards by providing noise control measures including engineering controls like acoustic insulation hoods, silencers, enclosures etc. on all sources of noise generation. The ambient noise level shall conform to the standards prescribed under The Environment (Protection) Act, 1986 & Rules.	Noted & complied, We are taking adequate measures so that ambient noise level due to our activities conform to the standards prescribed under The Environment (Protection) Act, 1986 & Rules. Annexure P has been attached herewith in the form of six-monthly Noise report conducted in the month of Jan'26.
A.7	CLEANER PRODUCTION AND WASTE MINIMISATION	
70	The unit shall undertake the Cleaner Production Assessment study through a reputed institute / organization and shall form a CP team in the company. The recommendations thereof along with the compliance shall be furnished to the GPCB	Noted, Plant has undertaken cleaner production activities.
71	The company shall undertake various waste minimization measures such as	Complied, This is being complied with and will continue.
	a Metering and control of quantities of active ingredients to minimize waste.	
	b Reuse of by-products from the process as raw materials or as raw materials substitutes	
	c Use of automated and close filling to minimize spillages.	

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

	d	Use of close feed system into batch reactors	
	e	Venting equipment through vapor recovery system	
	f	Use of high pressure hoses for cleaning to reduce wastewater generation	
	g	Recycling of washes to subsequent batches	Noted & Complied, Wash water generated during cleaning of vessels is reused back in the subsequent batches, as per the reuse plan and thereby reducing the consumption of fresh water in the product and hydraulic load to ETP. MTO used for cleaning is being reused in subsequent batches.
	h	Recycling of steam condensate	Noted & Complied, Steam Condensate is being recycled in plant.
	i	Sweeping / mopping of floor instead of floor washing to avoid effluent generation.	Noted & Complied, floor is swept / mopped regularly as a good practice.
	j	Regular preventive maintenance for avoiding leakage, spillage etc.	Noted.
A.8	GREEN BELT AND OTHER PLANTATION		
72		The unit shall develop green belt within premises as per the CPCB guidelines. However, if the adequate land is not available within the premises, the unit shall take up adequate plantation on road sides and suitable open areas in GIDC estate or any other open areas in consultation with the GIDC / GPCB and submit an action plan of plantation for next three years to the GPCB.	Noted & Complied, Adequate Green Belt is developed within premises. Current green belt area inside plant is 13516 sq. M. Trees are planted every year to increase the green belt. Also, in association with the Forest Department (Govt of Gujarat), we had developed a green belt on 10 acres of forest land using the concept of social forestry.
73		Drip irrigation / low-volume, low-angle sprinkler system shall be used for the green belt development within the premises	Noted, Same is being taken as design input and shall comply after proposed expansion.
B	OTHERS CONDITIONS		
74		All the recommendations, mitigation measures, environmental protection measures and safeguards proposed in the EIA report of the project prepared by M/s: Kadam Environmental Consultants, Vadodara was submitted by project proponent vide letter no. NIL dated 11/09/2017 and commitments made during presentation before SEAC and proposed in the EIA report shall be strictly adhered to in letter and spirit.	Noted, Commitments made during presentation before SEAC and proposed in the EIA report shall be adhered to in the amalgamated plot during and after completion of expansion project.
75		Rain water harvesting of surface as well as rooftop runoff shall be undertaken, and the same water shall be used for the various activities of the project to conserve fresh water as well as to recharge ground water. Before recharging the surface run off, pre-treatment must be done to remove suspended matter.	Noted, Roof top Rainwater harvesting structure will be installed and collected water will be reused inside factory operations, post completion of the expansion project.
76		The unit shall join and participate financially and technically for any common environmental facility / infrastructure as and when the same is taken up either by the Industrial Association or GIDC or GPCB or any such authority created for this purpose by the Govt. / GIDC.	Noted, Unit will evaluate and consider the need to join and participate for any common environmental facility / infrastructure as and when the same is taken up either by the GIDC or GPCB.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

77	Application of solar energy shall be incorporated for illumination of common areas, lighting for gardens and street lighting in addition the provision for solar water heating system shall also be provided.	Noted & Complied, Solar Energy is used at Plant for illumination of common areas. Solar energy generation details are attached as Annexure Q. Provision for Solar Water Heating will be explored for need and feasibility.
78	The area earmarked as green area shall be used only for plantation and shall not be altered for any other purpose.	Noted.
79	All the commitments / undertakings given to the SEAC during the appraisal process for the purpose of environmental protection and management shall be strictly adhered to.	Noted, All the commitments / undertakings given to the SEAC during the appraisal process for the purpose of environmental protection and management shall be adhered.
80	The project proponent shall also comply with any additional condition that may be imposed by the SEAC or the SEIAA or any other competent authority for the purpose for the environmental protection and management.	Noted.
81	In the event of failure of any pollution control system adopted by the unit, the unit shall be safely closed down and shall not be restarted until the desired efficiency of the control equipment has been achieved.	Noted.
82	The project authorities must strictly adhere to the stipulations made by the Gujarat Pollution Control Board (GPCB), State Government and any statutory authority.	Noted.
83	During material transfer there shall be no spillages and garland drain shall be constructed to avoid mixing of accidental spillages with domestic wastewater or storm water.	Noted & Complied, Plant has provisions for material transfer whereby eliminating the chances of spillage. Adequate measures shall be taken up to avoid mixing of accidental spillage with domestic wastewater or storm water.
84	Pucca flooring / impervious layer shall be provided in the work areas, chemical storage areas and chemical handling areas to minimize soil contamination.	Noted & Complied, Pucca flooring / impervious layer is provided in the work areas, chemical storage areas and chemical handling areas to minimize soil contamination.
85	Leakages from the pipes, pumps, shall be minimal and if occurs, shall be arrested promptly.	Noted & Complied, Provisions are made in the plant so that leakages from Pipes, Pumps are minimum.
86	No further expansion or modifications in the plant likely to cause environmental impacts shall be carried out without obtaining prior Environment Clearance from the concerned authority.	Noted, No further expansion or modifications likely to cause environmental impacts shall be carried out without obtaining prior Environment Clearance from SEIAA.
87	The above conditions will be enforced, inter-alia under the provisions of the Water (Prevention & Control of Pollution) Act, 1974, Air (Prevention & Control of Pollution) Act, 1981, the Environment (Protection) Act, 1986, Hazardous Wastes (Management, Handling and Transboundary Movement) Rules, 2008 and the Public Liability Insurance Act, 1991 along with their amendments and rules.	Noted, Unit post expansion shall comply with all the above conditions enforced.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

88	The project proponent shall comply all the conditions mentioned in "The Companies (Corporate Social Responsibility Policy) Rules, 2014" and its amendments from time to time in a letter and spirit.	Noted, Asian Paints company is complying to "The Companies (Corporate Social Responsibility Policy) Rules, 2014" and its amendments, in letter & spirit and is utilizing the funds earmarked for the benefit of society. The company will continue to comply in future as well.
89	The project management shall ensure that unit complies with all the environment protection measures, risk mitigation measures and safeguards recommended in the EMP report and risk Assessment study report as well as proposed by project proponent.	Noted,, Unit is following all the environment protection measures, risk mitigation measures and safeguards recommended in the EMP report and risk Assessment study report.
90	The project authority shall earmark adequate funds to implement the conditions stipulated by SEIAA as well as GPCB along with the implementation schedule for all the conditions stipulated herein. The funds so provided shall not be diverted for any other purpose.	Noted, Adequate funds shall be earmarked to implement the conditions stipulated by SEIAA as well as GPCB during execution of project at amalgamated plot.
91	The applicant shall inform the public that the project has been accorded environmental clearance by SEIAA and that the copies of the clearance letter are available with the GPCB and may also be seen in the Website of SEIAA/SEAC/GPCB. This shall be advertised within seven days from the date of the clearance letter, in at least two local newspapers that are widely circulated in the region, one of which shall be in the Gujarati language and the other in English. A copy of each of the same shall be forwarded to the Regional Office of the Ministry.	Noted & Complied, The advertisement in local newspapers, in English and Gujarati, regarding grant of EC by SEIAA has been published. Scanned copy of the newspaper is attached as Annexure R.
92	The project proponent shall also comply with any additional condition that may be imposed by the SEAC or the SEIAA or any other competent authority for the purpose for the environmental protection and management.	Noted, any additional condition that may be imposed by the SEAC or the SEIAA or any other competent authority for the purpose for the environmental protection and management shall be complied with.
93	It shall be mandatory for the project management to submit half yearly compliance report in respect of the stipulated prior environmental clearance terms and conditions in hard copy and soft copies to the regulatory authority concerned, on 1st June and 1st December of each calendar year.	Noted & Complied, Half yearly compliance with respect to EC conditions are being submitted regularly.
94	Concealing factual data submission of false/fabricated data and failure to comply with any of the conditions mentioned above may result in withdrawal of this clearance and attract action under the provisions of Environment (Protection) Act, 1986.	Noted, correct factual data is being submitted by the existing unit and same shall be continued post expansion.
95	The project authorities shall also adhere to the stipulations made by the Gujarat Pollution Control Board.	Noted, stipulations made by the Gujarat Pollution Control Board shall be complied to.
96	The SEIAA may revoke or suspend the clearance, if implementation of any of the above conditions is not found satisfactory.	Noted, conditions mentioned above shall be implemented.
97	The company in a time-bound manner shall implement these conditions. The SEIAA reserves the right to stipulate additional conditions, if the same is found necessary.	Noted.

Asian Paints Ltd.

Plot No 2702, 2703, 2602 to 2607 & 2609 to 2614 + 2701 A + 2701B,
GIDC Ind Estate, Ankleshwar 393002, Dist: Bharuch, Gujarat, India
HALF YEARLY EC COMPLIANCE REPORT_FY25-26 (Oct'25 - Mar'26)

98	The project authorities shall inform the GPCB, Regional Office of MoEF and SEIAA about the date of financial closure and the final approval of the project by the concerned authorities and the date of issue.	Noted, GPCB, Regional Office of MoEF and SEIAA shall be informed about the date of financial closure and the final approval of the proposed project by the concerned authorities and the date of issue.
99	The environment clearance is valid for seven years from the date of issue.	Noted.
100	Any appeal against this environmental clearance shall lie with the National Green Tribunal, if preferred, within a period of 30 days as prescribed under Section 16 of the National Green Tribunal Act, 2010.	Noted.
101	Submission of any false or misleading information or data which is material to screening or scoping or appeal or decision on the application makes this environmental clearance cancelled.	Noted.

INDEX

Sr.No.	LIST OF ANNEXURES	REFERENCE DETAIL
1	Annexure A	Production details
2	Annexure B	ZLD Certificate from GIDC
3	Annexure C	ETP Layout diagram with ZLD facility
4	Annexure D	Snap of Flow meters
5	Annexure E	Trade and Domestic effluent generation data
6	Annexure F	Storage tank snap for 72 hrs. period
7	Annexure G	Stack analysis report
8	Annexure H	VOC analysis report
9	Annexure I	AAQM monitoring report
10	Annexure J	TSDF membership certificate
11	Annexure K	Manifest copies for hazardous waste disposal
12	Annexure L	Hazardous waste coprocessing data
13	Annexure M	MSIHC data
14	Annexure N	List of fire extinguishers
15	Annexure O	Half Yearly Medical Report
16	Annexure P	Six monthly noise report
18	Annexure Q	Solar energy generation data
19	Annexure R	Scan of EC advertisement in newspaper

Annexure – A

Production details

Production details

Year	Total Paint Production (KL)	Synthetic Resins and Emulsions (MT)
2025-26	81705	22586
Month	Total Paint Production (KL)	Synthetic Resins and Emulsions (MT)
Oct-25	5485	1436
Nov-25	7982	2171
Dec-25	7191	1891
Jan-26	7943	2351
Feb-26	8458	2323
Mar-26	8342	2176
Total	45401	12348

Annexure – B

ZLD Certificate from GIDC

NOTIFIED AREA OFFICE
(GUJARAT INDUSTRIAL DEVELOPMENT CORPORATION)

Office of the Dy. Executive Engineer (Drainage)
Plot No. 618/619, AIA Community Centre,
GIDC, Ankleshwar-393 002.
Phone : 02646-251359
Fax : 02646-251750


Our Ref. No. : N.A./ANK/DEE/DRG/563

Date : 6 JUL 2018

CERTIFICATE

To whom so ever it may concern

This is to certify that M/s. Asian Paints Ltd; Plot No: 2602 at GIDC, Ankleshwar is now Zero Liquid Discharge Unit. The Drainage connection of this unit has been disconnected on dtd. 06-07-2018. At present this unit is not having any underground drainage connection to GIDC drainage network.


Dy. Ex-Engineer (Drg & Road)
N.A, GIDC, Ankleshwar.

To,
M/s. Asian Paints Ltd.
Plot No: 2602,
GIDC, Ankleshwar

NOTIFIED AREA OFFICE
(GUJARAT INDUSTRIAL DEVELOPMENT CORPORATION)

Office of the Dy. Executive Engineer (Drainage)
Plot No. 618/619, AIA Community Centre,
GIDC, Ankleshwar-393 002.
Phone : 02646-251359
Fax : 02646-251750

Our Ref. No. : N.A./ANK/DEE/DRGL1071

Date : 27 Dec 2019

CERTIFICATE

TO WHOM SO EVER IT MAY CONCERN

This is to certify that M/s. Asian Paints Ltd(Phthalic Division);
Plot No: 2702 at GIDC, Ankleshwar has applied to GPCB for Zero Liquid
Discharge. The Drainage connection of this unit has been disconnected
on dtd. 20-12-2019. At present this unit is not having any underground
drainage connection to GIDC drainage network.



Dy.Ex.Engineer (Drg & Road)
N.A, GIDC, Ankleshwar.

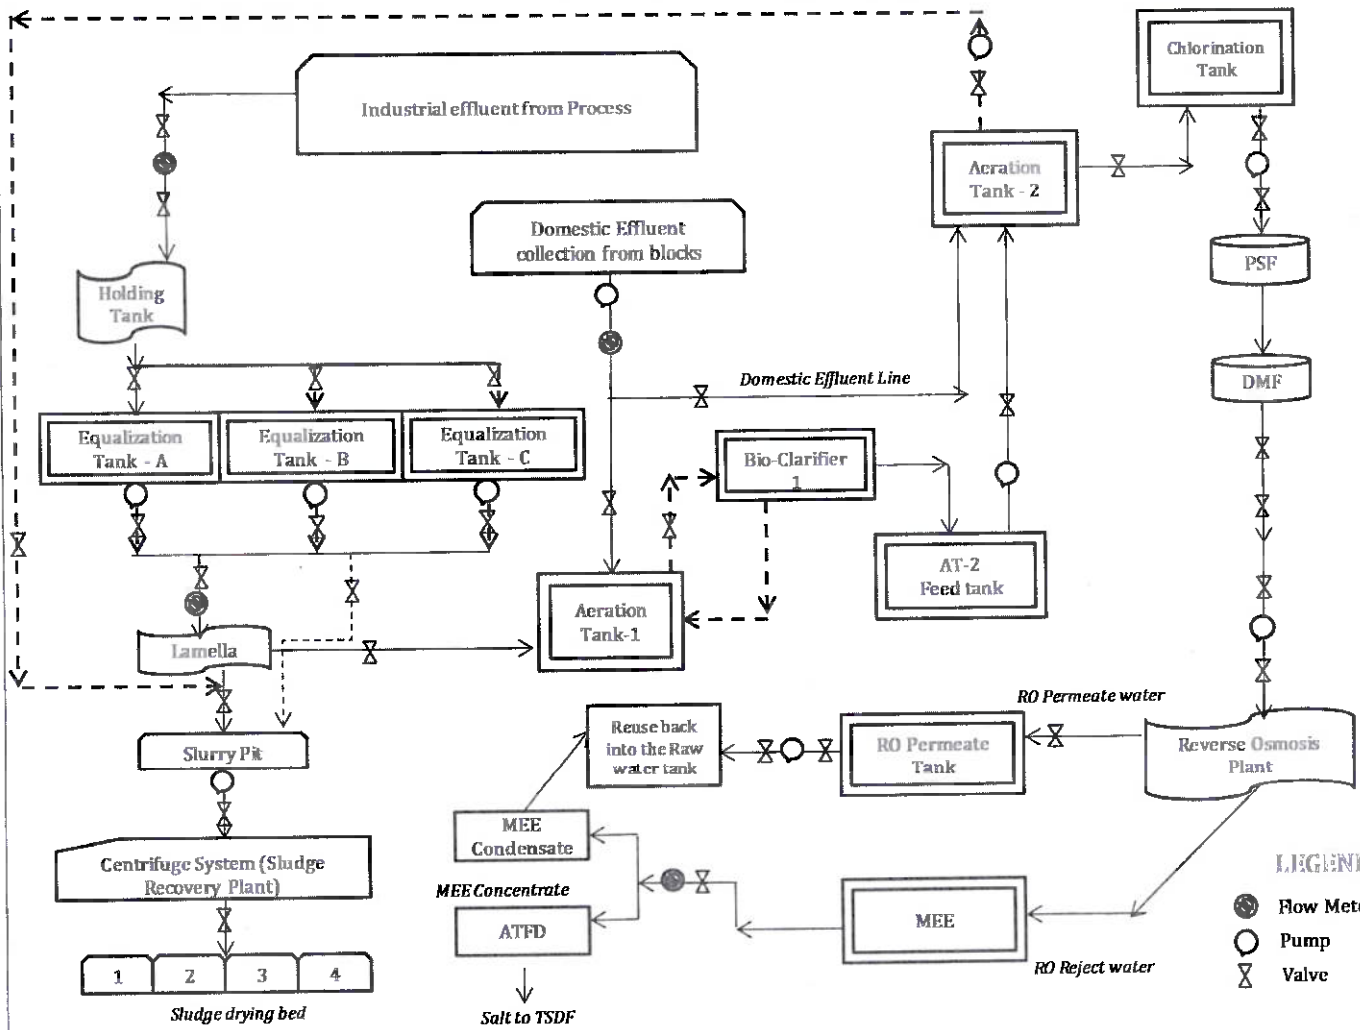
To,
M/s. Asian Paints Ltd.(Phthalic Division)
Plot No: 2702,
GIDC, Ankleshwar

Annexure – C

ETP Layout diagram with ZLD facility

ETP Layout diagram with ZLD facility

PFD for Ankleshwar plant : ETP

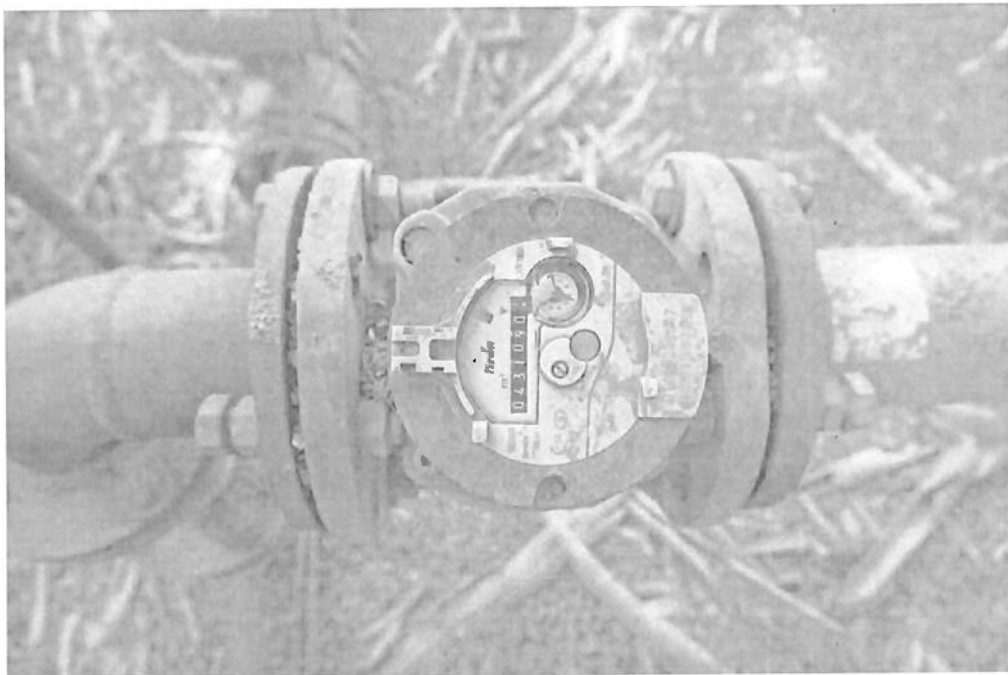


ETP capacity details		
S. No.	Tank Capacity	Capacity
1	Equalization Tank - A	32 KL
2	Equalization Tank - B	32 KL
3	Equalization Tank - C	28 KL
4	Aeration Tank - 1	90 KL
5	Bio Clarifier - 1	17 KL
6	Aeration Tank 2 cum bio clarifier	360 KL
7	Chlorination tank	6 KL
8	Pressure sand filter (Rate of filtration)	11.05 m3/m2.h
9	Activated Carbon filter (Rate of filtration)	11.05 m3/m2.h
10	Slurry Pit	7.8 KL
11	Centrifuge	5 m3/hr.
12	ETP Treated water Storage Tank	20 KL
13	RO Plant Feed Tank	100 KL
14	RO Plant	180 m3/Day
15	MEE Plant Feed tank	110 KL
16	MEE Plant	1.5 KL/hr.
17	RO Permeate tank	10 KL
18	MEE Condensate Tank	20 KL
19	Sludge Drying Bed - 1	18.9 KL
20	Sludge Drying Bed - 2	18.9 KL
21	Sludge Drying Bed - 3	18.9 KL
22	Sludge Drying Bed - 4	18.9 KL

Annexure – D

Snap of Flow meters

Snap of Flow meters



Annexure – E

Trade and Domestic effluent generation data

Trade and Domestic effluent generation data

Date	Oct-25		Nov-25		Dec-25	
	DOMESTIC EFFLUENT (KLD)	INDUSTRIAL EFFLUENT (KLD)	DOMESTIC EFFLUENT (KLD)	INDUSTRIAL EFFLUENT (KLD)	DOMESTIC EFFLUENT (KLD)	INDUSTRIAL EFFLUENT (KLD)
1	40	12	39	19	22	15
2	37	2	39	4	15	18
3	46	18	33	14	21	21
4	37	2	32	24	27	16
5	45	6	40	19	27	24
6	38	10	37	14	23	12
7	29	8	35	26	12	7
8	45	6	35	8	29	13
9	32	12	10	5	27	14
10	31	1	30	6	23	19
11	38	9	26	12	34	11
12	12	7	43	16	28	10
13	20	18	44	11	33	12
14	28	8	40	8	20	8
15	28	14	26	10	43	7
16	39	12	22	6	34	16
17	37	20	18	11	25	25
18	25	7	28	6	31	21
19	31	8	27	9	28	15
20	16	0	19	15	29	7
21	9	2	23	9	28	6
22	17	36	22	13	33	30
23	26	5	25	12	32	9
24	42	18	23	25	31	17
25	37	13	30	24	38	22
26	20	11	39	30	42	15
27	33	9	28	19	37	17
28	28	15	28	26	18	14
29	39	13	27	12	25	20
30	35	5	27	15	27	20
31	14	9	-	-	23	30
Max	46	36	44	30	43	30
Min	9	0	10	4	12	6
Avg	31	10	30	14	28	16
CCA Limit	162	118	162	118	162	118

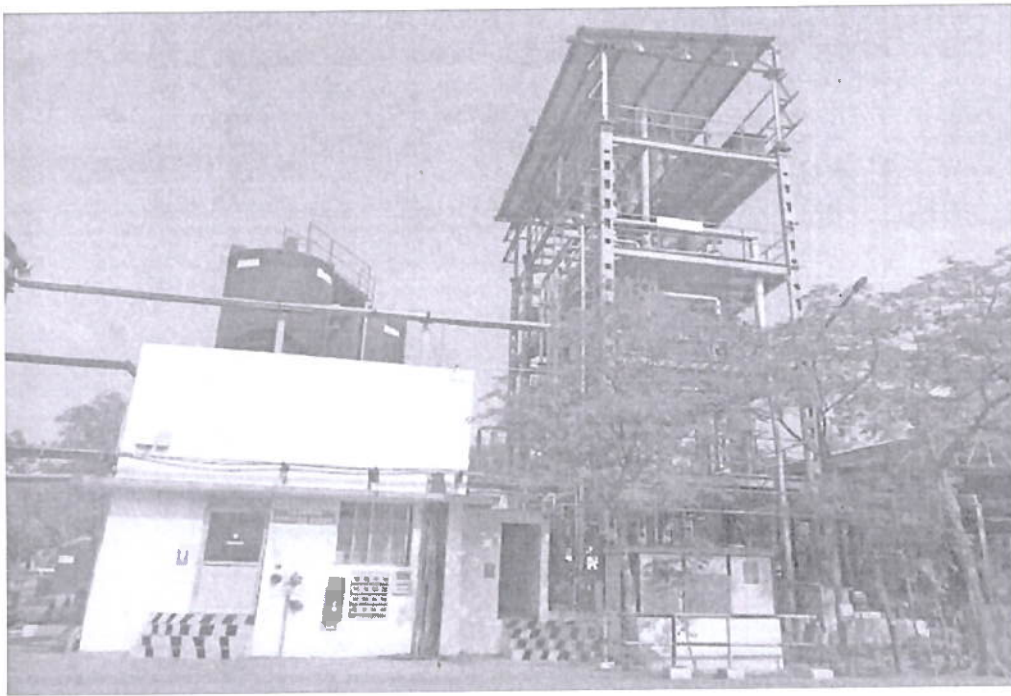
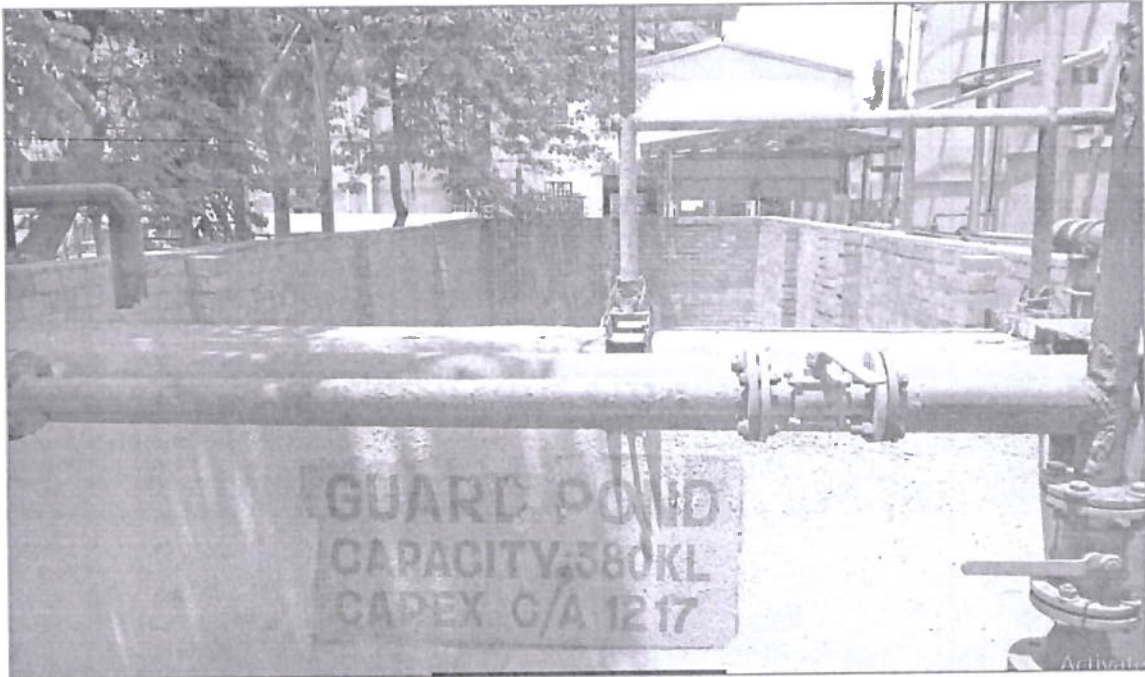
Trade and Domestic effluent generation data

Date	Jan-26		Feb-26		Mar-26	
	DOMESTIC EFFLUENT (KLD)	INDUSTRIAL EFFLUENT (KLD)	DOMESTIC EFFLUENT (KLD)	INDUSTRIAL EFFLUENT (KLD)	DOMESTIC EFFLUENT (KLD)	INDUSTRIAL EFFLUENT (KLD)
1	23	22	20	12	26	12
2	26	23	26	8	19	14
3	34	27	29	13	8	1
4	19	10	25	23	9	0
5	30	24	20	11	20	24
6	37	9	23	10	25	19
7	44	6	16	12	16	9
8	34	8	13	7	13	10
9	32	8	21	15	18	17
10	30	13	26	13	32	4
11	24	20	20	19	38	25
12	28	20	29	7	37	9
13	20	26	25	9	30	13
14	28	0	17	3	32	11
15	23	20	4	7	15	11
16	29	26	35	14	28	16
17	14	14	28	16	30	14
18	16	15	15	17	38	16
19	35	4	31	20	40	13
20	32	16	26	15	41	28
21	29	17	33	3	37	13
22	28	22	10	11	31	25
23	29	6	35	15	38	23
24	27	12	30	10	39	19
25	13	4	29	4	50	21
26	32	0	21	27	39	19
27	20	16	26	11	35	26
28	23	14	13	5	30	22
29	30	4	-	-	9	16
30	28	8	-	-	26	20
31	34	13	-	-	19	28
Max	44	27	35	27	50	28
Min	13	0	4	3	8	0
Avg	27	14	23	12	28	16
CCA Limit	162	118	162	118	162	118

Annexure – F

**Storage tank snap for
72 hrs. period**

Additional Effluent storage capacity



Guard pond of 380 KL capacity and underground storage tanks below the RO and MEE facilities with 100KL Storage each

Total Capacity is $380+100+100 = 580$ KL against the requirement of 540 KL (3 days*180 KL/day)

Annexure – G

Stack analysis report


Stack analysis report

Stack Sample details	Parameters	UOM	CCA Limit	Oct-25	Nov-25	Dec-25	Jan-26	Feb-26	Mar-26
Incinerator Stack	Particulate Matter	mg/Nm3	40	26.42	22.58	11.62	23.44	Not Operated	Not Operated
	Sulfur Dioxide as SO2	mg/Nm3	160	15.69	13.74	8.32	8.82		
	Oxides of Nitrogen as NOX	mg/Nm3	320	38.31	34.5	9.4	26.9		
	Hydrochloric Acid as HCl	mg/Nm3	40	5.45	4.84	1.8	4.52		
	Carbon Monoxide as CO	mg/Nm3	80	13.74	11.45	12.85	11.45		
	Hydrogen Fluoride as HF	µgm/m3	3.2	1.68	1.13	0.53	1.11		
	Organic Content-TOC	mg/l	16	ND	ND	1.57	ND		
	Lead as Pb	mg/l	0.4	0.22	0.25	0.005	0.182		
	Total Dioxin and Furans	ng/NM3	0.08	-	-	0.0003	-		
	Temperature of Flue Gas	°C	NS*	56	54	122	58		
	Velocity of flue Gas	m/sec	NS*	5.34	5.16	11.52	5.68		
	Oxygen as O2	%	NS*	10.8	10.5	5.11	10.6		
	Volumetric Flow Rate of Gas	Nm3/hr	NS*	5539	5298	7627.41	5944		
Thermo Pack TP 1 (1 & 2)	Temperature of Flue Gas	oC	NS*	121	120	118	120	118	119
	Velocity of flue Gas	m/sec	NS*	6.78	6.48	6.58	6.78	6.58	6.38
	Particulate Matter	mg/Nm3	120	ND	ND	ND	ND	ND	ND
	Sulfur Dioxide as SO2	ppm	80	5.3	6.8	6.5	6.9	6.3	5.3
	Oxides of Nitrogen as NOX	ppm	40	27.9	28.1	26.9	27.3	26.9	26.7
	Volumetric Flow Rate of Gas	m3/sec	NS*	1.31	1.23	1.31	1.23	1.22	1.26
	Carbon Dioxide as CO2	mg/kg	NS*	59400	59400	61200	61200	59400	61200
	Oxygen as O2	mg/kg	NS*	197659	197659	197659	197659	202895	19053
	Carbon Monoxide as CO	mg/kg	NS*	ND	ND	ND	ND	ND	ND
DG SET - 1 - GEN A 601 (320 KVA) - GATE 1	Temperature of Flue Gas	oC	NS*	144	142	146	145	134	132
	Velocity of flue Gas	m/sec	NS*	8.68	8.56	8.41	8.26	8.24	8.55
	Particulate Matter	mg/Nm3	120	22.47	18.4	21.59	20.8	25.64	23.42
	Sulfur Dioxide as SO2	ppm	80	5.58	9.2	6.56	5.9	6.32	5.5
	Oxides of Nitrogen as NOX	ppm	40	24.36	26.9	25.53	26.3	25.66	24.31
	Volumetric Flow Rate of Gas	m3/sec	NS*	0.27	0.26	0.26	0.24	0.26	0.27
	Carbon Dioxide as CO2	mg/kg	NS*	75600	75600	79200	75600	75600	79200
	Oxygen as O2	mg/kg	NS*	212058	210749	213367	210749	210749	212058
	Carbon Monoxide as CO	mg/kg	NS*	ND	ND	ND	ND	ND	ND
DG SET - 3 - GEN A 603 (320 KVA) - GATE 1	Temperature of Flue Gas	oC	NS*	132	128	130	131	126	128
	Velocity of flue Gas	m/sec	NS*	8.45	8.12	8.64	8.4	8.28	8.24
	Particulate Matter	mg/Nm3	120	23.55	20.75	18.65	12.59	10.47	12.3
	Sulfur Dioxide as SO2	ppm	80	5.86	5.5	6.32	5.13	6.39	5.2
	Oxides of Nitrogen as NOX	ppm	40	24.64	21.61	26.5	23.42	26.24	28.3
	Volumetric Flow Rate of Gas	m3/sec	NS*	0.27	0.26	0.27	0.26	0.26	0.23
	Carbon Dioxide as CO2	mg/kg	NS*	81000	79200	82800	75600	81000	75600
	Oxygen as O2	mg/kg	NS*	215985	212058	214676	212058	213367	218600
	Carbon Monoxide as CO	mg/kg	NS*	ND	ND	ND	ND	ND	ND
DG SET - 4 - GEN A 610 (500 KVA) - GATE 1	Temperature of Flue Gas	oC	NS*	118	120	126	128	124	125
	Velocity of flue Gas	m/sec	NS*	7.56	7.42	7.76	7.8	7.65	7.56
	Particulate Matter	mg/Nm3	120	17.6	22.41	17.61	10.29	14.51	13.2
	Sulfur Dioxide as SO2	ppm	80	5.15	5.45	6.33	5.4	6.28	5.9
	Oxides of Nitrogen as NOX	ppm	40	22.8	18.58	20.36	24.26	25.58	26.8
	Volumetric Flow Rate of Gas	m3/sec	NS*	0.24	0.23	0.24	0.24	0.24	0.22
	Carbon Dioxide as CO2	mg/kg	NS*	75600	79200	75600	79200	75600	81000

	Oxygen as O2	mg/kg	NS*	215985	212058	213367	214676	218603	213367
	Carbon Monoxide as CO	mg/kg	NS*	ND	ND	ND	ND	ND	ND
DG SET - 5 - GEN A 609 (1250 KVA) - GATE 1	Temperature of Flue Gas	oC	NS*	124	126	124	122	126	128
	Velocity of flue Gas	m/sec	NS*	8.24	8.41	8.31	8.11	7.88	7.72
	Particulate Matter	mg/Nm3	120	24.49	18.6	16.57	12.37	10.24	11.5
	Sulfur Dioxide as SO2	ppm	80	6.44	6.45	5.26	4.42	5.52	4.8
	Oxides of Nitrogen as NOX	ppm	40	21.44	22.58	18.51	20.23	23.36	25.1
	Volumetric Flow Rate of Gas	m3/sec	NS*	0.79	0.81	0.8	0.78	0.76	0.78
	Carbon Dioxide as CO2	mg/kg	NS*	73800	81000	73800	77400	77400	79200
	Oxygen as O2	mg/kg	NS*	214676	214676	210749	213367	215985	218603
	Carbon Monoxide as CO	mg/kg	NS*	ND	ND	ND	ND	ND	ND

Note:

NS* - NOT SPECIFIED, ND* - NOT DETECTED



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE

QF/7.8/20-ST

Page: 1 of 1

Customer's Name and Address :

M/S. ASIAN PAINTS LIMITED
2602, GIDC, INDUSTRIAL ESTATE,
ANKLESHWAR – 393 002
TEL NO. (02646) 678 000

Test Report No. : **PL/AP/26/01/003**
Issue Date : **15/01/2026**
Customer's Ref. : **PO. No. 0015413035**
Dated: 27/03/2025

STACK DETAILS

Sampling Location	: DG SET – 1 GEN A 601 (Near Gate 1) (320 KVA)	Sampling Procedure	: As per table
Sampling By	: Pollucon Laboratories Pvt. Ltd.	Protocol (purpose)	: Stack Monitoring
Date of Sampling	: 09/01/2026	Stack Height Ground Level	: 10 Meter
Date of Completion	: 15/01/2026	Fuel Used**	: HSD
Time of Sampling in Hrs	: 10:00 TO 11:00	Cross Section Area (m ²)	: 0.0314
Stack Diameter**	: 0.2 Meter		
Lab ID	: ASA/2601/18 [A-I]		

RESULT TABLE

SR. NO.	TEST PARAMETER	UNIT	RESULTS	GPCB LIMIT**	TEST/SAMPLING METHOD
1	Temperature of Flue Gas	°C	136	NS*	IS:11255 (Part-3)
2	Velocity of flue Gas	m/sec	8.20	NS*	IS:11255 (Part-3)
3	Particulate Matter	mg/Nm ³	14.29	120	IS 11255 (Part-1)
4	Sulfur Dioxide as SO ₂	ppm	6.21	80	IS 11255 (Part-2)
5	Oxides of Nitrogen as NO _x	ppm	21.63	40	IS 11255 (Part-7)
6	Volumetric Flow Rate of Gas	m ³ /sec	0.26	NS*	IS:11255 (Part-3)
7	Carbon Dioxide as CO ₂	mg/kg	82800	NS*	CPCB guidelines for source emission monitoring - Digital Gas Analyzers
8	Oxygen as O ₂	mg/kg	214676	NS*	
9	Carbon Monoxide as CO	mg/kg	Not Detected	NS*	

NS*: Not Specified,

**Details provided by customer.

Results on 11 % O₂ Correction when Oxygen is Greater than 11 % and 12 % CO₂ Correction when CO₂ is less than 12 %


Ravi Jariwala

Sr. Environmental Scientist


Dr. Arun Bajpai
Lab Manager (Q)

Note: This report is subject to terms & conditions mentioned over leaf.

*** End of Report ***

● Recognised Env. Lab under
Env. (Protection) Act-1986 (CPCB)

● Recognised Schedule II
Env. Auditor (GPCB)

● ZDHC Approved for
Wastewater Guidelines V2.2

● ISO 9001 / 14001 / 45001

"Pollucon House", Plot No. 5 & 6, Opp. Balaji Industrial Soc., Old Shantinath Silk Mill Lane, Navjivan Circle, Udhna Magdalla Road, Surat-395007, Gujarat, India.
Phone : 0261-2635750/51/75, Mo. 70166 05174, 70462 61750, WEB : www.polluconlab.com, E-mail : pollucon@gmail.com quotation@polluconlab.com



TEST CERTIFICATE

QF/7.8/20-ST

Page: 1 of 1

Customer's Name and Address :

M/S. ASIAN PAINTS LIMITED
2602, GIDC, INDUSTRIAL ESTATE,
ANKLESHWAR – 393 002
TEL NO. (02646) 678 000

Test Report No. : **PL/AP/26/01/004**
Issue Date : **15/01/2026**
Customer's Ref. : **PO. No. 0015413035**
Dated: 27/03/2025

STACK DETAILS

Sampling Location : **DG SET – 3 GEN A 603 (Near Gate 1) (320 KVA)**
Sampling By : **Pollucon Laboratories Pvt. Ltd.** Sampling Procedure : **As per table**
Date of Sampling : **09/01/2026** Protocol (purpose) : **Stack Monitoring**
Date of Completion : **15/01/2026** Stack Height Ground Level : **10 Meter**
Time of Sampling in Hrs : **11:10 TO 12:10** Fuel Used** : **HSD**
Stack Diameter** : **0.2 Meter** Cross Section Area (m²) : **0.0314**
Lab ID : **ASA/2601/19 [A-I]**

RESULT TABLE

S.R. NO.	TEST PARAMETER	UNIT	RESULTS	GPCB LIMIT**	TEST/SAMPLING METHOD
1	Temperature of Flue Gas	°C	131	NS*	IS:11255 (Part-3)
2	Velocity of flue Gas	m/sec	8.40	NS*	IS:11255 (Part-3)
3	Particulate Matter	mg/Nm ³	12.59	120	IS 11255 (Part-1)
4	Sulfur Dioxide as SO ₂	ppm	5.13	80	IS 11255 (Part-2)
5	Oxides of Nitrogen as NO _x	ppm	23.42	40	IS 11255 (Part-7)
6	Volumetric Flow Rate of Gas	m ³ /sec	0.26	NS*	IS:11255 (Part-3)
7	Carbon Dioxide as CO ₂	mg/kg	75600	NS*	CPCB guidelines for source emission monitoring - Digital Gas Analyzers
8	Oxygen as O ₂	mg/kg	212058	NS*	
9	Carbon Monoxide as CO	mg/kg	Not Detected	NS*	

NS*: Not Specified.

**Details provided by customer.

Results on 11 % O₂ Correction when Oxygen is Greater than 11 % and 12 % CO₂ Correction when CO₂ is less than 12 %



Ravi Jariwala
Sr. Environmental Scientist


Dr. Arun Bajpai
Lab Manager (Q)

Note: This report is subject to terms & conditions mentioned on leaf.


*** End of Report ***

● Recognised Env. Lab under
Env. (Protection) Act-1986 (CPCB)

● Recognised Schedule II
Env. Auditor (GPCB)

● ZDHC Approved for
Wastewater Guidelines V2.2

● ISO 9001 / 14001 / 45001



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE

QF/7.8/20-ST

Customer's Name and Address :

Page: 1 of 1

M/S. ASIAN PAINTS LIMITED 2602, GIDC, INDUSTRIAL ESTATE, ANKLESHWAR - 393 002 TEL NO. (02646) 678 000	Test Report No. : PL/AP/26/01/005 Issue Date : 15/01/2026 Customer's Ref. : PO. No. 0015413035 Dated: 27/03/2025
--	---

STACK DETAILS

Sampling Location	: DG SET- 4 GEN A 610 (Near Gate 1) (500 KVA)	Sampling Procedure	: As per table
Sampling By	: Pollucon Laboratories Pvt. Ltd.	Protocol (purpose)	: Stack Monitoring
Date of Sampling	: 09/01/2026	Stack Height Ground Level	: 10 Meter
Date of Completion	: 15/01/2026	Fuel Used**	: HSD
Time of Sampling in Hrs	: 12:20 TO 13:20	Cross Section Area (m ²)	: 0.0314
Stack Diameter**	: 0.2 Meter		
Lab ID	: ASA/2601/20 [A-I]		

RESULT TABLE

S.R. NO.	TEST PARAMETER	UNIT	RESULTS	GPCB LIMIT**	TEST/SAMPLING METHOD
1	Temperature of Flue Gas	°C	128	NS*	IS:11255 (Part-3)
2	Velocity of flue Gas	m/sec	7.80	NS*	IS:11255 (Part-3)
3	Particulate Matter	mg/Nm ³	10.29	120	IS 11255 (Part-1)
4	Sulfur Dioxide as SO ₂	ppm	5.40	80	IS 11255 (Part-2)
5	Oxides of Nitrogen as NO _x	ppm	24.26	40	IS 11255 (Part-7)
6	Volumetric Flow Rate of Gas	m ³ /sec	0.24	NS*	IS:11255 (Part-3)
7	Carbon Dioxide as CO ₂	mg/kg	79200	NS*	CPC3 guidelines for source emission monitoring - Digital Gas Analyzers
8	Oxygen as O ₂	mg/kg	214676	NS*	
9	Carbon Monoxide as CO	mg/kg	Not Detected	NS*	

NS*: Not Specified.

**Details provided by customer.

Results on 11 % O₂ Correction when O₂ is Greater than 11 % and 12 % CO₂ Correction when CO₂ is less than 12 %

Ravi Janwala
Sr. Environmental Scientist

Dr. Arun Bajpai
Lab Manager (Q)

Note: This report is subject to terms & conditions mentioned overleaf.

*** End of Report ***

● Recognised Env. Lab under
Env. (Protection) Act-1986 (CPCB)

● Recognised Schedule II
Env. Auditor (GPCB)

● ZDHC Approved for
Wastewater Guidelines V2.2

● ISO 9001 / 14001 / 45001

"Pollucon House", Plot No. 5 & 6, Opp. Balaji Industrial Soc., Old Shantlnath Silk Mill Lane, Navjivan Circle, Udhna Magdalla Road, Surat-395007, Gujarat, India.
Phone : 0261-2635750/51/75, Mo. 70166 05174, 70462 61750, WEB : www.polluconlab.com, E-mail : pollucon@gmail.com, quotation@polluconlab.com

TEST CERTIFICATE

QF/7.8/20-ST

Customer's Name and Address :

Page: 1 of 1

M/S. ASIAN PAINTS LIMITED 2602, GIDC, INDUSTRIAL ESTATE, ANKLESHWAR - 393 002 TEL NO. (02646) 678 000	Test Report No. : PL/AP/26/01/006 Issue Date : 15/01/2026 Customer's Ref. : PO. No. 0015413035 Dated: 27/03/2025
--	---

STACK DETAILS

Sampling Location	: DG SET - 5 GEN A 609 (Near Gate 1) (1250 KVA)	Sampling Procedure	: As per table
Sampling By	: Pollucon Laboratories Pvt. Ltd.	Protocol (purpose)	: Stack Monitoring
Date of Sampling	: 09/01/2026	Stack Height Ground Level	: 30 Meter
Date of Completion	: 15/01/2026	Fuel Used**	: HSD
Time of Sampling in Hrs	: 13:30 TO 14:30	Cross Section Area (m ²)	: 0.0961
Stack Diameter**	: 0.35 Meter		
Lab ID	: ASA/2601/21 [A-I]		

RESULT TABLE

Sr. No.	TEST PARAMETER	UNIT	RESULTS	GPCB LIMIT**	TEST/SAMPLING METHOD
1	Temperature of Flue Gas	°C	122	NS*	IS:11255 (Part-3)
2	Velocity of flue Gas	m/sec	8.11	NS*	IS:11255 (Part-3)
3	Particulate Matter	mg/Nm ³	12.37	120	IS 11255 (Part-1)
4	Sulfur Dioxide as SO ₂	ppm	4.42	80	IS 11255 (Part-2)
5	Oxides of Nitrogen as NO _x	ppm	20.23	40	IS 11255 (Part-7)
6	Volumetric Flow Rate of Gas	m ³ /sec	0.78	NS*	IS:11255 (Part-3)
7	Carbon Dioxide as CO ₂	mg/kg	77400	NS*	CPCB guidelines for source emission monitoring - Digital Gas Analyzers
8	Oxygen as O ₂	mg/kg	213367	NS*	
9	Carbon Monoxide as CO	mg/kg	Not Detected	NS*	

NS*: Not Specified,

**Details provided by customer.

Results on 11 % O₂ Correction when Oxygen is Greater than 11 % and 12 % CO₂ Correction when CO₂ is less than 12 %



Ravi Jariwala
Sr. Environmental Scientist


Dr. Arun Bajpai
Lab Manager (Q)

Note: This report is subject to terms & conditions mentioned overleaf.

*** End of Report ***

● Recognised Env. Lab under
Env. (Protection) Act-1986 (CPCB)

● Recognised Schedule II
Env. Auditor (GPCB)

● ZDHC Approved for
Wastewater Guidelines V2.2

● ISO 9001 / 14001 / 45001



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE

QF/7.8/20-ST

Page: 1 of 1

Customer's Name and Address :

M/S. ASIAN PAINTS LIMITED
PLOT NO.:2702, GIDC,
ANKLESHWAR - 393 002.

Test Report No. : PL/APA/26/01/004
Issue Date : 06/02/2026
Customer's Ref. : PO Number: 0015413034,
PO Date: 27.03.2025

STACK DETAILS

Sampling Location	: Thermopack Stack-1	Sampling Procedure	: As per table
Sampling By	: Pollucon Laboratories Pvt. Ltd.	Protocol (purpose)	: Stack Monitoring
Date of Sampling	: 31/01/2026	Stack Height Ground Level	: 36 Meter
Date of Completion	: 06/02/2026	Fuel Used**	: Natural Gas
Time of Sampling in Hrs	: 11:00 TO 12:00	Cross Section Area (m ²)	: 0.1962
Stack Diameter**	: 0.50 Meter		
Lab ID	: ASA/2601/01 [A-I]		

RESULT TABLE

SR. NO.	TEST PARAMETER	UNIT	RESULTS	GPCB LIMIT**	TEST/SAMPLING METHOD
1	Temperature of Flue Gas	°C	120	NS*	IS:11255 (Part-3)
2	Velocity of flue Gas	m/sec	6.78	NS*	IS:11255 (Part-3)
3	Particulate Matter	mg/Nm ³	LTAR(<3.0)	120	IS 11255 (Part-1)
4	Sulfur Dioxide as SO ₂	ppm	6.9	80	IS 11255 (Part-2)
5	Oxides of Nitrogen as NO _x	ppm	27.2	40	IS 11255 (Part-7)
6	Volumetric Flow Rate of Gas	m ³ /sec	1.23	NS*	IS:11255 (Part-3)
7	Carbon Dioxide as CO ₂	mg/kg	61200	NS*	CPCB guidelines for source emission monitoring - Digital Gas Analyzers
8	Oxygen as O ₂	mg/kg	197659	NS*	
9	Carbon Monoxide as CO	mg/kg	LTAR(<0.001)	NS*	

NS*: Not Specified.

**Details provided by customer.

Note : LTAR :- Lower Than Accreditation Range.

Results on 11 % O₂ Correction when Oxygen is Greater than 11 % and 12 % CO₂ Correction when CO₂ is less than 12 %


Ravi Janwala

Sr. Environmental Scientist


Dr. Arun Bajpai

Lab Manager (Q)

Note: This report is subject to terms & conditions mentioned on reverse.

End of Report

● Recognised Env. Lab under
Env. (Protection) Act-1986 (CPCB)

● Recognised Schedule II
Env. Auditor (GPCB)

● ZDHC Approved for
Wastewater Guidelines V2.2

● ISO 9001 / 14001 / 45001

"Pollucon House", Plot No. 5 & 6, Opp. Balaji Industrial Soc., Old Shantinath Silk Mill Lane, Navjivan Circle, Udhna Marg, Road, Surat-395007, Gujarat, India.
Phone : 0261-2635750/51/75, Mo. 70166 05174, 70482 61750, WEB : www.polluconlab.com, E-mail : pollucon@gmail.com, quotation@polluconlab.com

Annexure – H

Volatile Organic Compound analysis report



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE

QF/7.8/20-EX

Customer's Name and Address :

Page: 1 of 1

M/S. ASIAN PAINTS LIMITED PLOT NO.:2702, GIDC, ANKLESHWAR – 393 002.	Test Report No. : PL/APA/25/10/0004 Issue Date : 18/10/2025 Customer's Ref. : PO Number: 0015413034, PO Date: 27.03.2025
--	--

VOC RESULT

Date of Sampling : As per table	Test parameters : VOC
Sampling Team Member : Pollucon Laboratories Pvt. Ltd.	Test Method : VOC Meter
Description of Instrument Used : VOC Meter, Model: Photocheck TIGER, Make: ION Science, UK	

SR. NO.	LOCATION**	VOC in ppm		
		01/10/2025	08/10/2025	17/10/2025
1	EBG	5.3	4.5	3.9
2	RBG	2.8	3.2	5.2
3	WBG	4.6	5.1	6.9
4	SBG	4.9	4.4	3.1
5	EB- Ground Floor Filtration & Packing	6.2	5.8	4.7
6	EB - First Floor Reactor	7.9	7.1	8.9
7	EB- Second Floor -Pet	7.6	6.5	5.5
8	EB- Third Floor Batching Station	5.9	4.8	7.3
9	RB - Ground Floor Filtration & Packing	6.2	3.0	4.1
10	RB- First Floor Blender	3.2	6.8	2.5
11	RB- Second Floor Reactor	7.2	8.3	6.2
12	RB - Third Floor Hopper Charging & BT	3.2	2.1	5.7
13	SB- Ground Floor Packing	4.3	5.9	7.9
14	SB- Mezzanine Floor	5.8	6.7	4.3
15	SB- First Floor Processing	5.5	4.1	2.9
16	SB- Second Floor Pre Processing	6.2	5.3	3.3
17	SB- Third Floor Batching Station	8.5	7.3	6.7
18	WB- Ground Floor Packing	7.1	6.1	5.4
19	WB- Mezzanine Floor Hopper	4.8	3.7	3.4
20	WB- First Floor Processing	4.9	2.5	5.7
21	WB- Second Floor Pre Processing	3.6	4.8	8.3
22	WB- Third Floor Batching Station	8.9	6.4	7.5
23	SB PQC Lab	7.5	7.2	4.0
24	WB PQC Lab	2.4	8.1	8.5
25	EB PQC Lab	4.9	5.5	3.8
26	RB PQC Lab	4.8	2.9	7.6

** Details provided by customer.

H. T. Shah
Lab. Manager

Dr. Arun Bajpai
Lab Manager(Q)

Note: This report is subject to terms & conditions mentioned overleaf.

● Recognized by A5-FE, New Delhi Under Sec. 12 of Environmental Protection Act-1986 ● GPCB approved ● ISO 14001:2004 ● OHSAS 18001:2007 ● ISO 9001:2008

"Pollucon House", Plot No.5/6, Opp. Balaji Industrial Society, Old Shantinath Silk Mill Lane, Near Gaytri Farsan Mart, Navjivan Circle, Udhana Magdalla Road, Surat-395007, Gujarat, India.

Phone : 0261-2635750, 0261-2635751, 0261-2635775, 07016605174, WEB: www.polluconlab.com, E. mail: pollucon@gmail.com, info@polluconlab.com



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE

QF/7.8/20-EX

Customer's Name and Address :

Page: 1 of 1

M/S. ASIAN PAINTS LIMITED PLOT NO.:2702, GIDC, ANKLESHWAR – 393 002.	Test Report No. : PL/APA/25/11/0007 Issue Date : 06/12/2025 Customer's Ref. : PO Number: 0015413034, PO Date: 27.03.2025
---	---

VOC RESULT

Date of Sampling : As per table	Test parameters : VOC
Sampling Team Member : Pollucon Laboratories Pvt. Ltd.	Test Method : VOC Meter
Description of Instrument Used : VOC Meter, Model: Photocheck TIGER, Make: ION Science, UK	

SR. NO.	LOCATION**	VOC in ppm			
		04/11/2025	11/11/2025	18/11/2025	28/11/2025
1	EB- Ground Floor Filtration & Packing	6.9	6.1	5.7	6.4
2	EB - First Floor Reactor	7.6	7.9	6.7	6.0
3	RB - Ground Floor Filtration & Packing	7.8	6.5	5.8	8.2
4	SB- Ground Floor Packing	5.6	5.2	4.7	4.2
5	SB- First Floor Processing	4.9	4.4	3.4	3.2
6	EBG	5.6	5.9	6.3	5.1
7	SB PQC Lab	3.3	2.8	2.9	3.1
8	SB- Ground Floor Packing	8.9	8.1	7.7	7.4

** : Details provided by customer.

H. T. Shah
Lab. Manager

Dr. Aruh Bajpai
Lab Manager (Q)

Note: This report is subject to terms & conditions mentioned overleaf.

End of Report

● Recognised Env. Lab under
Env. (Protection) Act-1986 (CPCB)

● Recognised Schedule II
Env. Auditor (GPCB)

● ZDHC Approved for
Wastewater Guidelines V2.2

● ISO 9001 / 14001 / 45001

"Pollucon House", Plot No. 5 & 6, Opp. Balaji Industrial Soc., Old Shantinath Silk Mill Lane, Navjivan Circle, Udhna Magdalla Road, Surat-395007, Gujarat, India.
Phone : 0261-2635750/51/75, Mo. 70166 05174, 70482 61760, WEB : www.polluconlab.com, E-mail : pollucon@gmail.com quotation@polluconlab.com



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE

QF/7.8/20-EX

Customer's Name and Address :

Page: 1 of 1

M/S. ASIAN PAINTS LIMITED PLOT NO.:2702, GIDC, ANKLESHWAR – 393 002.	Test Report No. : PL/APA/25/12/0016 Issue Date : 31/12/2025 Customer's Ref. : PO Number: 0015413034, PO Date: 27.03.2025
---	---

VOC RESULT

Date of Sampling	: As per table	Test parameters	: VOC
Sampling Team Member	: Pollucon Laboratories Pvt. Ltd.	Test Method	: VOC Meter
Description of Instrument Used	: VOC Meter, Model: Photocheck TIGER, Make: ION Science, UK		

SR. NO.	LOCATION**	VOC in ppm			
		04/12/2025	11/12/2025	18/12/2025	25/12/2025
1	EB- Ground Floor Filtration & Packing	5.9	6.2	6.8	6.2
2	EB - First Floor Reactor	5.3	4.8	4.2	5.9
3	RB - Ground Floor Filtration & Packing	8.4	8.2	7.2	7.6
4	SB- Ground Floor Packing	5.1	4.6	5.9	6.8
5	SB- First Floor Processing	3.5	3.2	2.9	2.8
6	EBG	4.5	4.9	4.2	4.0
7	SB PQC Lab	2.3	2.5	1.4	1.9
8	SB- Ground Floor Packing	5.9	6.2	6.8	6.2

** : Details provided by customer.


H. T. Shah

Lab. Manager


Dr. Arun Bajpai

Lab Manager(Q)

Note: This report is subject to terms & conditions mentioned overleaf.

- Recognised Env. Lab under Env. (Protection) Act-1986 (CPCB)
- Recognised Schedule II Env. Auditor (GPCB)
- ZDHC Approved for Wastewater Guidelines V2.2
- ISO 9001 / 14001 / 45001

"Pollucon House", Plot No. 5 & 9, Opp. Dabhi Industrial Soc., Old Shantinath Suk Mill Lane, Navjivan Circle, Udhna Magdalla Road, Surat-395007, Gujarat, India.
Phone : 0261-2635750/51/75, Mo. 70166 05174, 70462 61750, WEB : www.polluconlab.com, E-mail : pollucon@gmail.com, quotation@polluconlab.com



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE

QF/7.8/20-EX

Customer's Name and Address :

Page: 1 of 1

M/S. ASIAN PAINTS LIMITED
PLOT NO.:2702, GIDC,
ANKLESHWAR – 393 002.


Test Report No. : **PL/APA/26/01/003**
Issue Date : **31/01/2026**
Customer's Ref. : **PO Number: 0015413034, PO**
Date: 27.03.2025


VOC RESULT

Date of Sampling : **As per table** Test parameters : **VOC**
Sampling Team Member : **Pollucon Laboratories Pvt. Ltd.** Test Method : **VOC Meter**
Description of Instrument Used : **VOC Meter, Model: Photocheck TIGER, Make: ION Science, UK**

SR. NO.	LOCATION**	VOC in ppm			
		03/01/2026	09/01/2026	16/01/2026	23/01/2026
1	EB- Ground Floor Filtration & Packing	3.6	4.2	4.5	4.7
2	EB - First Floor Reactor	6.4	6.7	5.9	5.8
3	RB - Ground Floor Filtration & Packing	4.5	4.3	4.8	4.9
4	SB- Ground Floor Packing	6.8	7.6	7.1	6.8
5	SB- First Floor Processing	5.4	6.3	6.5	4.8
6	EBG	2.4	2.8	2.5	3.2
7	SB PQC Lab	2.1	1.5	1.9	2.4
8	WB- Ground Floor Packing	3.6	4.2	4.5	4.7

** Details provided by customer.


H. T. Shah
Lab. Manager


Dr. Arun Bajpai
Lab Manager (Q)

Note: This report is subject to terms & conditions mentioned overleaf.

End of Report

● Recognised Env. Lab under
Env. (Protection) Act-1986 (CPCB)

● Recognised Schedule II
Env. Auditor (GPCB)

● ZDHC Approved for
Wastewater Guidelines V2.2

● ISO 9001 / 14001 / 45001

"Pollucon House", Plot No. 5 & 6, Opp. Balaaji Industrial Soc., Old Shantinath Silk Mill Lane, Navjivan Circle, Udhna Magdalla Road, Surat-395007, Gujarat, India.
Phone : 0261-2635750/51/75, Mo. 70166 05174, 70462 61750, WEB : www.polluconlab.com, E-mail : pollucon@gmail.com quotation@polluconlab.com



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE

QF/7.8/20-EX

Customer's Name and Address :

Page: 1 of 1

M/S. ASIAN PAINTS LIMITED PLOT NO.:2702, GIDC, ANKLESHWAR – 393 002.	Test Report No. : PL/APA/26/02/002 Issue Date : 02/03/2026 Customer's Ref. : PO Number: 0015413034, PO Date: 27.03.2025
---	--

VOC RESULT

Date of Sampling	: As per table	Test parameters	: VOC
Sampling Team Member	: Pollucon Laboratories Pvt. Ltd.	Test Method	: VOC Meter
Description of Instrument Used	: VOC Meter, Model: Photocheck TIGER, Make: ION Science, UK		

SR. NO.	LOCATION**	VOC in ppm			
		03/02/2026	10/02/2026	17/02/2026	24/02/2026
1	EB- Ground Floor Filtration & Packing	3.8	3.0	2.4	4.1
2	EB - First Floor Reactor	4.9	4.3	3.2	5.4
3	RB - Ground Floor Filtration & Packing	6.4	5.6	7.4	6.1
4	SB- Ground Floor Packing	4.7	3.9	2.6	6.3
5	SB- First Floor Processing	2.8	4.4	6.4	4.1
6	EBG	4.1	2.6	5.1	3.4
7	SB PQC Lab	6.0	5.7	2.5	5.8
8	WB- Ground Floor Packing	3.8	3.0	2.4	4.1

** Details provided by customer.


H. T. Shah
Lab. Manager


Dr. Arun Bajpai
Lab Manager(Q)

Note: This report is subject to terms & conditions mentioned overleaf.

- Recognized Env. Lab under Env. (Protection) Act-1986 (CPCB)
- Recognized Schedule II Env. Auditor (GPCB)
- ZDHC Approved for Wastewater Guidelines V2.2
- ISO 9001 / 14001 / 45001

"Pollucon House", Plot No. 5 & 6, Opp. Dabhi Industrial Soc., Old Shantilal Silk Mill Lane, Navjivan Circle, Udhna Magdalla Road, Surat-395007, Gujarat, India.
Phone : 0261-2635750/51/75, Mo. 70106 05174, 70462 81750, WEB : www.polluconlab.com, E-mail : pollucon@gmail.com, quotation@polluconlab.com



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE

QF/7.8/20-EX

Customer's Name and Address :

Page: 1 of 1

M/S. ASIAN PAINTS LIMITED PLOT NO.:2702, GIDC, ANKLESHWAR – 393 002.	Test Report No. : PL/APA/26/03/003 Issue Date : 30/03/2026 Customer's Ref. : PO Number: 0015413034, PO Date: 27.03.2025
--	---

VOC RESULT

Date of Sampling : As per table	Test parameters : VOC
Sampling Team Member : Pollucon Laboratories Pvt. Ltd.	Test Method : VOC Meter
Description of Instrument Used : VOC Meter, Model: Photocheck TIGER, Make: ION Science, UK	

SR. NO.	LOCATION**	VOC in ppm			
		05/03/2026	11/03/2026	17/03/2026	27/03/2026
1	EB- Ground Floor Filtration & Packing	4.2	3.4	2.8	4.5
2	EB - First Floor Reactor	5.3	4.7	3.6	5.8
3	RB - Ground Floor Filtration & Packing	6.8	6.0	7.8	6.5
4	SB- Ground Floor Packing	5.1	4.3	3.0	6.7
5	SB- First Floor Processing	3.2	4.8	6.8	4.5
6	EBG	4.5	3.0	5.5	3.8
7	SB PQC Lab	6.4	6.1	2.9	6.2
8	WB- Ground Floor Packing	4.2	3.4	2.8	4.5

** : Details provided by customer.


H. T. Shah
Lab. Manager


Dr. Arun Bajpai
Lab Manager(Q)

Note: This report is subject to terms & conditions mentioned overleaf.

- Recognised Env. Lab under Env. (Protection) Act-1986 (CPCB)
- Recognised Schedule II Env. Auditor (GPCB)
- ZDHC Approved for Wastewater Guidelines V2.2
- ISO 9001 / 14001 / 45001

"Pollucon House", Plot No. 5 & 6, Opp. Goleji Industrial Soc., Old Shantinath Silk Mill Lane, Navjivan Circle, Udhna Magdalla Road, Surat-395007, Gujarat, India.
Phone : 0261-2635750/51/75, Mo. 70155 05174, 70462 61750, WEB : www.polluconlab.com, E-mail : pollucon@gmail.com, quotation@polluconlab.com

Annexure – I

Ambient Air Quality Monitoring report



POLLUCON LABORATORIES PVT. LTD.

TEST REPORT FOR AMBIENT AIR QUALITY MONITORING

QF/7.8/20-AQ

Page: 1 of 1

Customer's Name and Address :

M/S. ASIAN PAINTS LIMITED 2602, GIDC, INDUSTRIAL ESTATE, ANKLESHWAR – 393 002 TEL NO. (02646) 678 000	Test Report No. : PL/AP/25/10/0019 Issue Date : 04/11/2025 Customer's Ref. : PO. No. 0015413035 Dated: 27/03/2025
--	--

Location of Sampling : New Ware House	Sampling Procedure : As per table
Date of Sampling : As per table	Protocol (Purpose) : Ambient Air Quality Monitoring
Sampling By : Pollucon Laboratories Pvt. Ltd.	Lab Id : As per table
Sampling Duration : 24 Hrs.	

RESULT TABLE

TEST PARAMETER	UNIT	DATE OF SAMPLING									LIMIT*	TEST / SAMPLING METHOD
		03/10/ 2025	07/10/ 2025	10/10/ 2025	14/10/ 2025	17/10/ 2025	23/10/ 2025	24/10/ 2025	28/10/ 2025	31/10/ 2025		
Lab ID (ASA/2510) [A - H]		01	10	23	29	33	37	41	45	49		
Respirable Particulate Matter (PM ₁₀)	µg/m ³	73.31	86.47	66.45	89.38	75.68	85.44	61.25	67.66	88.16	100	IS 5182 (Part-23)
Particulate Matter (PM _{2.5})	µg/m ³	44.26	50.32	36.66	51.78	34.58	46.64	31.57	37.71	48.48	60	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Sulphur Dioxide as SO ₂	µg/m ³	13.63	16.63	23.30	21.44	18.34	25.35	14.95	19.74	24.95	80	IS 5182 (Part-2)
Oxides of Nitrogen as NO ₂	µg/m ³	33.55	30.38	37.60	29.84	26.63	38.53	27.39	32.65	41.16	80	IS 5182 (Part-6)
Ozone (O ₃) ⁵	µg/m ³	18.45	15.30	27.32	29.41	22.12	26.40	30.75	25.60	28.41	180	IS 5182 (Part 9)
Carbon Monoxide as CO	mg/m ³	0.98	0.81	0.92	0.97	0.85	1.10	0.86	0.78	1.08	04	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Ammonia as NH ₃	µg/m ³	29.48	21.64	31.23	24.02	33.28	22.46	26.92	28.84	37.41	400	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Benzene as C ₆ H ₆	µg/m ³	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	05	IS 5182 (Part-11)
Benzo (a) Pyrene (BaP)- Particulate Phase Only	ng/m ³	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	01	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Arsenic as As	ng/m ³	LTAR (<2.0)	2.57	LTAR (<2.0)	2.35	LTAR (<2.0)	2.43	LTAR (<2.0)	LTAR (<2.0)	2.19	06	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Nickel as Ni	ng/m ³	LTAR (<0.5)	8.09	LTAR (<0.5)	10.54	LTAR (<0.5)	6.98	LTAR (<0.5)	LTAR (<0.5)	10.38	20	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Lead as Pb	µg/m ³	LTAR (<0.1)	0.42	LTAR (<0.1)	0.62	LTAR (<0.1)	0.34	LTAR (<0.1)	LTAR (<0.1)	0.26	01	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Hydrocarbon as HC	µg/m ³	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	NS*	Digital Gas Analyzer
Hydrochloric Acid as HCl	µg/m ³	16.70	20.54	27.21	25.26	21.95	29.92	17.94	22.94	28.49	NS*	SOP HCl – 01
Chlorine	µg/m ³	LTAR (<15)	16.74	23.81	21.26	18.35	25.42	LTAR (<15)	19.24	24.34	NS*	IS 5182 (Part 19)
Hydrogen Sulphide as H ₂ S	µg/m ³	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	NS*	IS 5182 (Part-7)

Note: Limit# as per Industrial, Residential, Rural and other Area Notification Dated 18th Nov.2009 as per national Ambient Air Quality Standards, CPCB New Delhi.

5: Ozone (O₃) sampling duration 1 hrs and sample Analyzed on same Day, Carbon Monoxide (CO): Sampling 1 Hrs.

Note : LTAR :- Lower Than Accreditation Range.

Ravi Jariwala
Sr. Environmental Scientist

Dr. Arun Bajpai
Lab Manager(Q)

Note: This report is subject to terms & conditions mentioned overleaf.

● Recognised by MoEF, New Delhi Under
Sec. 12 of Environmental Protection Act-1986

● GPCB approved
● Include in monitor

● ISO 14001 : 2004 ● OHSAS 18001 : 2007 ● ISO 9001 : 2008

**"Pollucon House", Plot No.5/6, Opp.Balaji Industrial Society, Old Shantinath Silk Mill Lane, Near Gaytri Farsan Mart,
Navjivan Circle,Udhana Magdalla Road, Surat-395007, Gujarat, India.**

Phone : 0261-2635750, 0261-2635751, 0261-2635775, 07016605174. WEB: www.polluconlab.com, E. mail: pollucon@gmail.com, info@polluconlab.com

TEST REPORT FOR AMBIENT AIR QUALITY MONITORING

QF/7.8/20-AQ

Page: 1 of 1

Customer's Name and Address :

M/S. ASIAN PAINTS LIMITED
2602, GIDC, INDUSTRIAL ESTATE,
ANKLESHWAR – 393 002
TEL NO. (02646) 678 000

 Test Report No. : **PL/AP/25/10/0020**
 Issue Date : **04/11/2025**
 Customer's Ref. : **PO. No. 0015413035**
Dated: 27/03/2025

Location of Sampling : ETP Date of Sampling : As per table Sampling By : Pollucon Laboratories Pvt. Ltd. Sampling Duration : 24 Hrs.	Sampling Procedure : As per table Protocol (Purpose) : Ambient Air Quality Monitoring Lab Id : As per table
---	--


RESULT TABLE

TEST PARAMETER	UNIT	DATE OF SAMPLING									LIMIT*	TEST / SAMPLING METHOD
		03/10/ 2025	07/10/ 2025	10/10/ 2025	14/10/ 2025	17/10/ 2025	23/10/ 2025	24/10/ 2025	28/10/ 2025	31/10/ 2025		
Lab ID (ASA/2510) [A - H]		02	11	24	30	34	38	42	46	50		
Respirable Particulate Matter (PM ₁₀)	µg/m ³	69.35	81.07	60.25	84.56	70.52	78.52	55.82	63.53	82.88	100	IS 5182 (Part-23)
Particulate Matter (PM _{2.5})	µg/m ³	40.24	44.57	33.45	48.34	32.14	41.46	30.55	34.33	47.76	60	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Sulphur Dioxide as SO ₂	µg/m ³	12.73	19.46	22.27	10.26	16.08	24.39	14.23	18.51	20.41	80	IS 5182 (Part-2)
Oxides of Nitrogen as NO ₂	µg/m ³	32.54	28.44	33.22	27.48	23.94	34.34	25.63	29.30	38.46	80	IS 5182 (Part-6)
Ozone (O ₃) ^S	µg/m ³	15.86	18.39	30.42	25.58	23.55	27.57	20.87	22.46	26.87	180	IS 5182 (Part-9)
Carbon Monoxide as CO	mg/m ³	0.61	0.88	0.79	0.72	0.80	1.01	0.74	1.17	0.96	04	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Ammonia as NH ₃	µg/m ³	27.42	24.98	26.47	20.77	30.42	17.66	23.73	28.58	32.94	400	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Benzene as C ₆ H ₆	µg/m ³	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	05	IS 5182 (Part-11)
Benzo (a) Pyrene (BaP)- Particulate Phase Only	ng/m ³	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	01	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Arsenic as As	ng/m ³	LTAR (<2.0)	2.45	LTAR (<2.0)	2.25	LTAR (<2.0)	2.19	LTAR (<2.0)	LTAR (<2.0)	2.13	06	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Nickel as Ni	ng/m ³	LTAR (<5.0)	6.53	LTAR (<5.0)	9.96	LTAR (<5.0)	5.91	LTAR (<5.0)	LTAR (<5.0)	10.04	20	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Lead as Pb	µg/m ³	LTAR (<0.1)	0.34	LTAR (<0.1)	0.55	LTAR (<0.1)	0.22	LTAR (<0.1)	LTAR (<0.1)	0.15	01	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Hydrocarbon as HC	µg/m ³	LTAR($<$ 150)	LTAR($<$ 150)	LTAR($<$ 150)	LTAR($<$ 150)	LTAR($<$ 150)	LTAR($<$ 150)	LTAR($<$ 150)	LTAR($<$ 150)	LTAR($<$ 150)	NS*	Digital Gas Analyzer
Hydrochloric Acid as HCl	µg/m ³	18.34	23.65	26.48	13.54	19.69	27.62	17.44	22.14	20.24	NS*	SOP HCl – 01
Chlorine	µg/m ³	LTAR (<15)	19.65	25.62	LTAR (<15)	16.39	24.31	LTAR (<15)	18.34	22.04	NS*	IS 5182 (Part-19)
Hydrogen Sulphide as H ₂ S	µg/m ³	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	NS*	IS 5182 (Part-7)

Note: Limit# as per Industrial, Residential, Rural and other Area Notification Dated 18th Nov.2009 as per national Ambient Air Quality Standards, CPCB New Delhi.

 S: Ozone (O₃) sampling duration 1 hrs and sample Analyzed on same Day, Carbon Monoxide (CO): Sampling 1 Hrs.

Note: LTAR :- Lower Than Accreditation Range.


Ravi Jariwala
Sr. Environmental Scientist

Dr. Arun Bajpai
Lab Manager(Q)

Note: This report is subject to terms & conditions mentioned overleaf.

• Recognized by MOEF, New Delhi Under Section 12 of Environmental Protection Act-1986 • ISO 14001:2004 • OHSAS 18001:2007 • ISO 9001:2008
 Schedule II and Part

"Pollucon House", Plot No.5/6, Opp.Balaji Industrial Society, Old Shantinath Silk Mill Lane, Near Gaytri Farsan Mart,
Navjivan Circle,Udhana Magdalla Road, Surat-395007, Gujarat, India.

Phone : 0261-2635750, 0261-2635751, 0261-2635775, 07016605174, WEB: www.polluconlab.com, E. mail: pollucon@gmail.com, info@polluconlab.com



TEST REPORT FOR AMBIENT AIR QUALITY MONITORING

QF/7.8/20-AQ

Page: 1 of 1

Customer's Name and Address :

M/S. ASIAN PAINTS LIMITED
2602, GIDC, INDUSTRIAL ESTATE,
ANKLESHWAR – 393 002
TEL NO. (02646) 678 000

Test Report No. : **PL/AP/25/10/0021**
Issue Date : **04/11/2025**
Customer's Ref. : **PO. No. 0015413035**
Dated: 27/03/2025

Location of Sampling : **Canteen**
Date of Sampling : **As per table**
Sampling By : **Pollucon Laboratories Pvt. Ltd.**
Sampling Duration : **24 Hrs.**
Sampling Procedure : **As per table**
Protocol (Purpose) : **Ambient Air Quality Monitoring**
Lab Id : **As per table**

RESULT TABLE

TEST PARAMETER	UNIT	DATE OF SAMPLING									LIMIT*	TEST / SAMPLING METHOD
		03/10/ 2025	07/10/ 2025	10/10/ 2025	14/10/ 2025	17/10/ 2025	23/10/ 2025	24/10/ 2025	28/10/ 2025	31/10/ 2025		
Lab ID (ASA/2510) [A - H]		03	12	25	31	35	39	43	47	51		
Respirable Particulate Matter (PM ₁₀)	µg/m ³	55.65	68.12	56.42	71.58	54.64	67.52	45.47	51.65	65.48	100	IS 5182 (Part-23)
Particulate Matter (PM _{2.5})	µg/m ³	28.41	32.47	29.96	38.42	26.48	33.56	20.32	25.64	31.68	60	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Sulphur Dioxide as SO ₂	µg/m ³	9.69	13.95	19.56	16.24	12.86	17.47	11.76	15.35	10.79	80	IS 5182 (Part-2)
Oxides of Nitrogen as NO ₂	µg/m ³	15.23	23.48	28.81	19.69	25.76	21.34	18.33	16.27	24.52	80	IS 5182 (Part-6)
Ozone (O ₃) [§]	µg/m ³	25.41	16.39	14.47	12.37	19.56	15.28	17.93	13.53	21.58	180	IS 5182 (Part 9)
Carbon Monoxide as CO	mg/m ³	0.45	0.36	0.64	0.50	0.44	0.82	0.47	0.84	0.73	04	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Ammonia as NH ₃	µg/m ³	17.52	21.41	16.30	18.22	22.66	19.32	15.60	23.57	26.68	400	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Benzene as C ₆ H ₆	µg/m ³	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	05	IS 5182 (Part-11)
Benzo (a) Pyrene (BaP)- Particulate Phase Only	ng/m ³	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	01	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Arsenic as As	ng/m ³	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	06	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Nickel as Ni	ng/m ³	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	20	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Lead as Pb	µg/m ³	LTAR (<0.1)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	01	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Hydrocarbon as HC	µg/m ³	LTAR(< 150)	LTAR(< 150)	LTAR(< 150)	LTAR(< 150)	LTAR(< 150)	LTAR(< 150)	LTAR(< 150)	LTAR(< 150)	LTAR(< 150)	NS*	Digital Gas Analyzer
Hydrochloric Acid as HCl	µg/m ³	13.35	17.48	22.79	19.82	16.20	20.76	14.74	18.96	12.34	NS*	SOP HCl – 01
Chlorine	µg/m ³	LTAR (<15)	LTAR (<15)	19.19	17.62	LTAR (<15)	16.96	LTAR (<15)	15.34	LTAR (<15)	NS*	IS 5182 (Part 19)
Hydrogen Sulphide as H ₂ S	µg/m ³	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	NS*	IS 5182 (Part-7)

Note: Limit# as per Industrial, Residential, Rural and other Area Notification Dated 18th Nov.2009 as per national Ambient Air Quality Standards, CPCB New Delhi.

§: Ozone (O₃) sampling duration 1 hrs and sample Analyzed on same Day, Carbon Monoxide (CO): Sampling 1 Hrs.

Note: LTAR :- Lower Than Accreditation Range.

Ravi Jariwala
Sr. Environmental Scientist

Dr. Arun Bajpai
Lab Manager(Q)

Note: This report is subject to terms & conditions mentioned overleaf.

• Recognised by MoEF, New Delhi Under

• CPCB Approved

• ISO 14001 : 2004

• OHSAS 18001 : 2007

• ISO 9001 : 2008

Sec. 12 of Environmental Protection Act-1986

- scheduled Auditor

"Pollucon House", Plot No.5/6, Opp.Balaji Industrial Society, Old Shantinath Silk Mill Lane, Near Gaytri Farsan Mart,
Navjivan Circle, Udhana Magdalla Road, Surat-395007, Gujarat, India.

Phone : 0261-2635750, 0261-2635751, 0261-2635775, 07016605174, WEB: www.polluconlab.com, E. mail: pollucon@gmail.com, info@polluconlab.com



TEST REPORT FOR AMBIENT AIR QUALITY MONITORING

QF/7.8/20-AQ
Page: 1 of 1

Customer's Name and Address :

M/S. ASIAN PAINTS LIMITED
2602, GIDC, INDUSTRIAL ESTATE,
ANKLESHWAR – 393 002
TEL NO. (02646) 678 000

Test Report No. : PL/AP/25/10/0022
Issue Date : 04/11/2025
Customer's Ref. : PO. No. 0015413035
Dated: 27/03/2025

Location of Sampling : Admin Building
Date of Sampling : As per table
Sampling By : Pollucon Laboratories Pvt. Ltd.
Sampling Duration : 24 Hrs.
Sampling Procedure : As per table
Protocol (Purpose) : Ambient Air Quality Monitoring
Lab Id : As per table

RESULT TABLE

TEST PARAMETER	UNIT	DATE OF SAMPLING									LIMIT [#]	TEST / SAMPLING METHOD
		03/10/2025	07/10/2025	10/10/2025	14/10/2025	17/10/2025	23/10/2025	24/10/2025	28/10/2025	31/10/2025		
Lab ID (ASA/2510) [A - H]		04	13	26	32	36	40	44	48	52		
Respirable Particulate Matter (PM ₁₀)	µg/m ³	64.22	57.33	46.72	54.32	61.32	73.21	49.34	55.74	72.23	100	IS 5182 (Part-23)
Particulate Matter (PM _{2.5})	µg/m ³	35.47	27.37	24.23	30.33	33.68	37.52	25.36	29.29	39.49	60	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Sulphur Dioxide as SO ₂	µg/m ³	11.88	18.59	16.28	14.46	9.28	19.14	8.83	17.53	12.41	80	IS 5182 (Part-2)
Oxides of Nitrogen as NO ₂	µg/m ³	14.53	22.77	19.57	21.52	15.52	23.41	16.54	24.83	18.43	80	IS 5182 (Part-6)
Ozone (O ₃) ^S	µg/m ³	22.27	13.24	23.12	18.62	12.63	21.44	15.34	20.67	14.35	180	IS 5182 (Part 9)
Carbon Monoxide as CO	mg/m ³	0.34	0.55	0.62	0.65	0.32	0.58	0.53	0.69	0.52	04	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Ammonia as NH ₃	µg/m ³	21.55	15.63	19.64	14.66	24.37	16.56	18.52	22.24	20.31	400	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Benzene as C ₆ H ₆	µg/m ³	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	05	IS 5182 (Part-11)
Benzo (a) Pyrene (BaP)- Particulate Phase Only	ng/m ³	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	LTAR (<0.5)	01	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Arsenic as As	ng/m ³	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	LTAR (<2.0)	06	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Nickel as Ni	ng/m ³	LTAR (<5.0)	LTAR (<5.0)	LTAR (<5.0)	LTAR (<5.0)	LTAR (<5.0)	LTAR (<5.0)	LTAR (<5.0)	LTAR (<5.0)	LTAR (<5.0)	20	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Lead as Pb	µg/m ³	LTAR (<0.1)	LTAR (<0.1)	LTAR (<0.1)	LTAR (<0.1)	LTAR (<0.1)	LTAR (<0.1)	LTAR (<0.1)	LTAR (<0.1)	LTAR (<0.1)	01	CPCB Guidelines for AAQM (Vol. I, NAAQMS/36/2012-13)
Hydrocarbon as HC	µg/m ³	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	LTAR(<150)	NS*	Digital Gas Analyzer
Hydrochloric Acid as HCl	µg/m ³	15.34	22.64	20.20	17.94	12.76	23.42	10.34	16.48	14.34	NS*	SOP HCl – 01
Chlorine	µg/m ³	LTAR (<15)	21.34	16.70	LTAR (<15)	LTAR (<15)	19.33	LTAR (<15)	LTAR (<15)	LTAR (<15)	NS*	IS 5182 (Part 19)
Hydrogen Sulphide as H ₂ S	µg/m ³	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	LTAR (<6.0)	NS*	IS 5182 (Part-7)

Note: Limit# as per Industrial, Residential, Rural and other Area Notification Dated 18th Nov.2009 as per national Ambient Air Quality Standards, CPCB New Delhi.
S: Ozone (O₃) sampling duration 1 hrs and sample Analyzed on same Day, Carbon Monoxide (CO): Sampling 1 Hrs.
Note: LTAR :- Lower Than Accreditation Range.

Ravi Jariwala

Ravi Jariwala
Sr. Environmental Scientist

Dr. Arun Bajpai

Dr. Arun Bajpai
Lab Manager(Q)

Note: This report is subject to terms & conditions mentioned overleaf.

• Recognised by MoEF, New Delhi Under
Sec. 12 of Environmental Protection Act 1986

• CPCB Approved
Schedule II Auditor

• ISO 14001:2001 • OHSAS 18001:2007 • ISO 9001:2008

"Pollucon House", Plot No.5/6, Opp.Balaji Industrial Society, Old Shantlnath Silk Mill Lane, Near Gaytri Farsan Mart,
Navjivan Circle, Udhana Magdalla Road, Surat-395007, Gujarat, India.

Phone : 0261-2635750, 0261-2635751, 0261-2635775, 07016605174, WEB: www.polluconlab.com, E. mail: pollucon@gmail.com, info@polluconlab.com

Annexure – J

TSDf membership certificate

Membership Certificate

Bharuch Enviro Infrastructure Limited (BEIL) – Common Incineration Facility



BHARUCH ENVIRO INFRASTRUCTURE LIMITE

October 31, 2005

M/s. Asian Paints Ltd. (Paint Div.)
Plot No. 2602,
GIDC, Ankleshwar.


Sub : Membership Certificate for Common Incineration Facility.

Dear Sir,

We hereby certify that you have become member for the common incineration facility of Bharuch Enviro Infrastructure Ltd., at GIDC, Ankleshwar. You have booked quantity of 156 MT/Year. Your Membership No. is CI/Ank./033.

Thanking you,

Yours faithfully,
For BHARUCH ENVIRO INFRASTRUCTURE LTD.


AUTHORISED SIGNATORY



Membership Certificate

Bharuch Enviro Infrastructure Limited (BEIL) – Common Solid Waste Disposal



BHARUCH ENVIRO INFRASTRUCTURE LIMITED

October 31, 2005

M/s. Asian Paints Ltd. (Paint Div.)
Plot No. 2602,
GIDC, Ankleshwar.

Sub : Membership Certificate for Common Solid Waste Disposal Facility.

Dear Sir,

We hereby certify that you have become member for the common Solid/Hazardous waste disposal facility of Bharuch Enviro Infrastructure Ltd., at GIDC, Ankleshwar. You have booked solid waste quantity of 500 MT/year. Your Membership No. is Ank./092.

Thanking you,

Yours faithfully,
For BHARUCH ENVIRO INFRASTRUCTURE LTD.

AUTHORISED SIGNATORY



Annexure – K

Manifest copies for hazardous waste disposal

BEIL INFRASTRUCTURE LIMITED -- [14983]
(Hazardous Waste Manifest)

Manifest No: 3074835
Manifest Date: 11/10/2025

Copy1

To be forwarded by the occupier to the State Pollution Control Board or Committee.

Sender's Details					
Sender Name	Asian Paints Ltd - [14937]				
Address	2602, City - ANKLESHWAR Taluka :ANK Distict.ANK Pin no.393002				
Contact Details	9925270903, malay.mankad@a asianpaints.com	GPS Coordinates	Lat: ,Long:		
Guardian Detail	...				
Receiver's Details					
State	Gujarat	Type of Facility	Pre processing		
Facility Details	BEIL INFRASTRUCTURE LIMITED - [14983]	Intremediat Facility			
Contact Details	8238040998, dalwadibd/a beil.co in	GPS Coordinates	Lat: 21.616265593533978, Long: 73.04892407902906		
Address	9701-16, 9801-28,9901-28,9601-04,10001-10008,G-7&8,7924-27,--- 9401-9412,9501-9506,7905 E to H, GIDC, Ankleshwar City - Ankleshwar Taluka -ANK Distict-ANK Pin no:393002				
Waste Details					
Waste Details	I-35-35.3-Chemical sludge from waste water treatment				
Waste Intended for	PPRO	Total Qty	14.150MT	Consistency	Solid
Transporter Details					
Name	PURVA ENTERPRISE	Contact Details	9428850037 purvaenterprise73@gmail.com		
Address	A78 GANESHPARKRESIDENCY SARDARPARK GIDC ANKLESHWAR A78 GANESHPARKRESIDENCY SARDARPARK GIDC ANKLESHWAR				
Vehicle Details					
Vehicle no	GJ16W8873(IMEI No:863070045896791)		GPS Enabled	Yes	
Driver name	Chandan Jha	Driver Contact No	7317737882	Type of Vehicle	Truck
Waste Transportation Details					
Vehicle Depart.	Number of Drums		0.	Loose Waste	14.150
Remarks	Chemical sludge from 111'		No of bags	0	
Sender's Declaration: (1) The above contents of hazardous/ other wastes consignment are fully and accurately described above by proper shipping name and are categorized, packed, marked and labeled, and are in proper conditions for its transport from aforementioned location to common facility or captive facility or actual facility by way of transport in accordance with the applicable central as well as state government regulations. (2) I have obtained membership of common facilities, carried out agreement with actual user for disposal/ actual use of hazardous waste having authorization under Rule-9. (3) I do hereby verify that no part of manifest is false and nothing has been concealed. If any information sprouts to be false or concealed, I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof.					
Name and stamp of sender:			Date: 11.10.2025	Signature:	
Transporter's Acknowledgement of Receipt of Waste Stamp: PURVA ENTERPRISE Date: 11.10.2025 Signature:					
Receiver's Certificate of Receipt of Hazardous Waste I, hereby declare (Sardar Park, G.I.D.C., Ankleshwar-02) unit for which I have valid CCA (under Rule-9 in case of recycling) for its disposal/ utilization. I also declare this information to be true failing which I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof. I hereby, accept/ reject the manifest.					
Stamp:		Date:		Signature:	

J.K.Cement Works, Mangrol -- [1000005]
(Hazardous Waste Manifest)

Manifest No: 3096660
Manifest Date: 06/11/2025

Copy1

To be forwarded by the occupier to the State Pollution Control Board or Committee.

Sender's Details			
Sender Name	Asian Paints Ltd. - [14937]		
Address	2602, City : ANKLESHWAR Taluka :ANK Distict:ANK Pin no:393002		
Contact Details	9925270903, malay.mankad@asianpaints.com	GPS Coordinates	Lat: ,Long:
Guardian Detail	...		
Receiver's Details			
State	Rajasthan	Type of Facility	Co- processing
Facility Details	J.K.Cement Works, Mangrol - [1000005]	Intremediat Facility	
Contact Details	9799978922, jay.kumar@jkcement.com	GPS Coordinates	Lat: 24.6964, Long: 74.6796
Address	Kailash nagar, Nimbahera City :Nimbahera Taluka :Nimbahera Distict:Chittorgarh		
Waste Details			
Waste Details	I-35~35.3~Chemical sludge from waste water treatment~~		
Waste Intended for	CPRO	Total Qty	17.210MT
		Consistency	Solid
Transporter Details			
Name	SAI WASTE MANAGMENT	Contact Details	9824544438 rohit@peregrine.co.in
Address	A1110 , Diamond Estate ,Motali Ankleshwar, GIDC Ankleshwar-393002		
Vehicle Details			
Vehicle no	GJ15AV1686(IMEI No:869604061241344)	GPS Enabled	Yes
Driver name	KALIM	Driver Contact No	9662277713
		Type of Vehicle	Truck
Waste Transportation Details			
Vehicle Depart.	Number of Drums	0	Loose Waste
Remarks	ETP sludge	No of bags	0
Sender's Declaration: (1) The above contents of hazardous/ other waste are fully and accurately described above by proper shipping name and are categorized, packed, marked and labeled, and are in all respects in proper conditions for its transport from aforementioned location to common facility or captive facility or actual use by way of road/ transportation in accordance with the applicable central as well as state government regulations. (2) I have obtained membership of common facilities/ carried out agreement with actual user for disposal/ actual use of hazardous waste having authorization under Rule-9. (3) I do hereby verify that no part of manifest is false and nothing has been concealed. If any information sprouts to be false or concealed, I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof.			
Name and stamp of sender:		Date: 06.11.2025	Signature:
Transporter's Acknowledgement of Receipt of Waste Stamp: SAI WASTE MANAGMENT CO.		Date: 06.11.2025	Signature:
Receiver's Certification of Receipt of Hazardous Waste I, hereby declare that the said waste is received at the facility and for which I have valid CCA (under Rule-9 in case of recycling) for its disposal/ utilization. I hereby, accept reject the manifest.			
In Principal Approval Details :Accepted - 06/11/2025 2:02PM - Remarks :Accepted			

Stamp: _____

Date: _____

Signature: _____

By scanning QR code, copy of transporter will be display. (All copy has same information)

Print by: 14937 @06/11/2025 53678524-49F8-4FFF-BE1F-14:10:27 1554A99C6F0A

J.K.Cement Works, Mangrol -- [1000005]
(Hazardous Waste Manifest)

Manifest No: 3110868
Manifest Date: 10/11/2025

Copy1

To be forwarded by the occupier to the State Pollution Control Board or Committee.

Sender's Details					
Sender Name	Asian Paints Ltd. - [14937]				
Address	2602, City : ANKLESHWAR Taluka : ANK District: ANK Pin no: 393002				
Contact Details	9925270903, malay.mankad@asianpaints.com	GPS Coordinates		Lat: , Long:	
Guardian Detail	...				
Receiver's Details					
State	Rajasthan	Type of Facility	Co- processing		
Facility Details	J.K.Cement Works, Mangrol - [1000005]	Intermediat Facility			
Contact Details	9799978922, jay.kumar@jkcement.com	GPS Coordinates	Lat: 24.6964, Long: 74.6796		
Address	Kailash nagar, Nimbahera City : Nimbahera Taluka : Nimbahera District: Chittorgarh				
Waste Details					
Waste Details	1- 35-35.3-Chemical sludge from waste water treatment---				
Waste Intended for	CPRO	Total Qty	17.320MT	Consistency	Solid
Transporter Details					
Name	Sai waste Management co	Contact Details	9824544438 rohit@ peregrine co.in		
Address	A 110, Diamond Estate, Motali Ankleshwar				
Vehicle Details					
Vehicle no	GJ16AU8658(IMEI No:862095058991206)		GPS Enabled	Yes	
Driver name	AJAHARUDDIN	Driver Contact No	6392236402	Type of Vehicle	Truck
Waste Transportation Details					
Vehicle Depart.	Number of Drums		0	Loose Waste	17 320
Remarks	ETP chemical sludge		No of bags	0	
Sender's Declaration: (1) The above contents of hazardous/ other waste are fully and accurately described above by proper shipping name and are categorized, packed, marked and labeled, and are in all respects in proper conditions for its transport from aforementioned location to common facility or captive facility or actual user by way of road transportation in accordance with the applicable central as well as state government regulations. (2) I have obtained membership of common facilities/ carried out agreement with actual user for disposal/ actual use of hazardous waste having authorization under Rule-9. (3) I declare/ verify that no part of manifest is false and nothing has been concealed. If any information sprouts to be false or concealed, I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof.					
Name and stamp of sender:			Date: 10.11.2025	Signature:	
Transporter's Acknowledgement of Receipt of Waste Stamp: SAI WASTE MANAGEMENT CO.					
Date: 10.11.2025			Signature:		
Receiver's Certification of Receipt of Hazardous Waste I, hereby declare that the said waste is received at the facility/ unit for which I have valid CCA (under Rule-9 in case of recycling) for its disposal/ utilization. I also declare this information to be true/ valid which I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof. I hereby, accept/ reject the manifest.					
In Principal Approval Details :Accepted - 10/11/2025 2:22PM - Remarks :Accepted					

Stamp: _____ Date: _____ Signature: _____

By scanning QR code, copy of transporter will be display. (All copy has same information)

Print by: 14937
@10/11/2025 14:27:26



ABD23C39-1C71-4FDB-965E-
3D01FC62BADB

BEIL INFRASTRUCTURE LIMITED -- [14983]
(Hazardous Waste Manifest)

Manifest No: 3157591
Manifest Date: 17/12/2025

Copy1

To be forwarded by the occupier to the State Pollution Control Board or Committee.

Sender's Details					
Sender Name	Asian Paints Ltd. - [14937]				
Address	2602, City : ANKLESHWAR Taluka : ANK Distict:ANK Pin no:393002				
Contact Details	9925270903, malay.mankad@asianpaints.com	GPS Coordinates	Lat: ,Long:		
Guardian Detail	...				
Receiver's Details					
State	Gujarat	Type of Facility	Common TSDF		
Facility Details	BEIL INFRASTRUCTURE LIMITED - [14983]	Intermediate Facility			
Contact Details	8238040998, dalwadibd@beil.co.in	GPS Coordinates	Lat: 21.616265593533978, Long: 73.04892407902906		
Address	9701-16, 9801-28, 9901-28, 9601-04, 10001-10008, G-7&8, 7924-27, --- 9401-9412, 9501-9506, 7905 E to H, GIDC, Ankleshwar City : Ankleshwar Taluka : ANK Distict:ANK Pin no:393002				
Waste Details					
Waste Details	I-35~35.3~Chemical sludge from waste water treatment---				
Waste Intended for	COTSDF	Total Qty	10.890MT ✓	Consistency	Solid
Transporter Details					
Name	PURVA ENTERPRISE	Contact Details	9428850037 purvaenterprise@gmail.com		
Address	78 Gnaesh Park Residency Sardar park Ankleshwar, GIDC				
Vehicle Details					
Vehicle no	GJ16W1743(IMEI No:869137064898224)		GPS Enabled	Yes	
Driver name	Vikash Yadav	Driver Contact No	9327760377	Type of Vehicle	Truck
Waste Transportation Details					
Vehicle Depart.		Number of Drums	0	Loose Waste	10.890
Remarks	ETP sludge from wastewater treatment			No of bags	0
Sender's Declaration: (1) The above contents of hazardous/ other wastes consignment are fully and accurately described above by proper shipping name and are categorized, packed, marked and labeled, and are in proper conditions for its transport from aforesaid location to common facility or captive facility or actual user by way of road transportation in accordance with the applicable central as well as state government regulations. (2) I have obtained membership of common facilities carried out agreement with actual user for disposal/ actual use of hazardous waste having authorization under Rule-9. (3) I do hereby verify that no part of manifest is false and nothing has been concealed. If any information sprouts to be false or concealed, I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof.					
Name and stamp of sender:		Date: 17.12.2025		Signature: 	
Transporter's Acknowledgement of Receipt of Waste Stamp:  Date: 17.12.2025 Signature: 					
Receiver's Certification of Receipt of Hazardous Waste I, hereby declare that the said waste is received at the facility/unit for which I have valid CCA (under Rule-9 in case of recycling) for its disposal/ utilization. I also declare this information to be true failing which I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof. I hereby accept/ reject the manifest.					

Stamp:

Date:



Signature:

BEIL INFRASTRUCTURE LIMITED - [14983]
(Hazardous Waste Manifest)

Manifest No: 3169146
Manifest Date: 26/12/2025

Copy1

To be forwarded by the occupier to the State Pollution Control Board or Committee.

Sender's Details					
Sender Name	Asian Paints Ltd. - [14937]				
Address	2602, City : ANKLESHWAR Taluka :ANK Dist:ANK Pin no.393002				
Contact Details	9925270903, malay.mankad@asianpaints.com		GPS Coordinates	Lat: ,Long:	
Guardian Detail	...				
Receiver's Details					
State	Gujarat	Type of Facility	Common TSDF		
Facility Details	BEIL INFRASTRUCTURE LIMITED - [14983]		Intermediat Facility		
Contact Details	8238040998, dalwadibd@beil.co.in		GPS Coordinates	Lat: 21.616265593533978, Long: 73.04892407902906	
Address	9701-16, 9801-28, 9901-28, 9601-04, 10001-10008, G-7&8, 7024-27, 9401-9412, 9501-9506, 7905 E to H, GIDC, Ankleshwar City : Ankleshwar Taluka :ANK Dist:ANK Pin no:393002				
Waste Details					
Waste Details	I-35-35.3-Chemical sludge from waste water treatment---				
Waste Intended for	COTSDF	Total Qty	11.510MT	Consistency	Solid
Transporter Details					
Name	PURVA ENTERPRISE	Contact Details	9428850037 purvaenterprise73@gmail.com		
Address	A 78 GANESH PARK RESIDENCY SARDAR PARK GIDC Ankleshwar				
Vehicle Details					
Vehicle no	GJ16W8873(IMEI No:863070045896791)		GPS Enabled	Yes	
Driver name	Chandan Jha	Driver Contact No	7317737882	Type of Vehicle	Truck
Waste Transportation Details					
Vehicle Depart.	Number of Drums		0	Loose Waste	11.510
Remarks	ETP SLUDGE		No of bags	0	
Sender's Declaration: (1) The above contents of hazardous/ other wastes consignment are fully and accurately described above by proper shipping name and are categorized, packed, marked and labeled, and are in all respects in proper conditions for its transport from aforementioned location to common facility or captive facility or actual user by way of road/ transportation in accordance with the applicable central as well as state government regulations. (2) I have obtained membership of common facilities/ carried out agreement with actual user for disposal/ actual use of hazardous waste having authorization under Rule-9. (3) I do hereby verify that no part of manifest is false and nothing has been concealed. If any information sprouts to be false or concealed, I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof. Name and stamp of sender:  Date: 26.12.2025 Signature: 					
Transporter's Acknowledgement of Receipt of Waste Stamp:  Date: 26.12.2025 Signature: 					
Receiver's Certification of Receipt of Hazardous Waste I, hereby declare that the said waste is received at the facility/unit for which I have valid CCA (under Rule-9 in case of recycling) for its disposal/ utilization. I also declare this information to be true failing which I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof. I hereby, accept reject the manifest.					

Stamp:

Date:

Signature:

J.K.Cement Works, Mangrol - [1000005]
(Hazardous Waste Manifest)

Manifest No: 3179211
Manifest Date: 03/01/2026

Copy 1

To be forwarded by the occupier to the State Pollution Control Board or Committee.

Sender's Details					
Sender Name	Asian Paints Ltd. - [14937]				
Address	2602, City : ANKLESHWAR Taluka : ANK Distict. ANK Pin no: 393002				
Contact Details	9925270903, malay.mankad@asianpaints.com	GPS Coordinates	Lat: , Long:		
Guardian Detail	...				
Receiver's Details					
State	Rajasthan	Type of Facility	Co- processing		
Facility Details	J K Cement Works, Mangrol - [1000005]	Intremediat Facility			
Contact Details	9799978922, jay.kumar@jkcement.com	GPS Coordinates	Lat: 24.6964, Long: 74.6796		
Address	Kailash nagar, Nimbahera City : Nimbahera Taluka : Nimbahera Distict: Chittorgarh				
Waste Details					
Waste Details	I-35 - 35.3 - Chemical sludge from waste water treatment--				
Waste Intended for	CPRO	Total Qty	18.620MT	Consistency	Solid
Transporter Details					
Name	Sai waste managment	Contact Details	9824544438 SWMC @ PI REGRINE.CO.IN		
Address	BEHIND MAHADEV HOTEL NH NO 08 AT 7 POST MOTALI 393001				
Vehicle Details					
Vehicle no	GJ16AW0258 (IMEI No: 869270043501112)		GPS Enabled	Yes	
Driver name	Tarif	Driver Contact No	7651946319	Type of Vehicle	Truck
Waste Transportation Details					
Vehicle Depart.		Number of Drums	0	Loose Waste	18.620
Remarks	TERM Card Form 9 attached here with. Chemical sludge from ETP.			No of bags	42
Sender's Declaration: (1) The above contents of hazardous/ other wastes consignment are fully and accurately described above by proper shipping name and are categorized, packed, marked and labeled in all respects in proper conditions for its transport from aforementioned location to common facility or captive facility for actual use by way of road/ transportation in accordance with the applicable central as well as state government regulations. (2) I have obtained membership of common facilities carried out agreement with actual user for disposal/ actual use of hazardous waste having authorization under Rule-9. (3) I do hereby verify that no part of manifest is false and nothing has been concealed. If any information sprouts to falsify or concealment will be held responsible for the consequences under HJOWM Rules, 2016 and amendments thereof.					
Name and stamp of sender:		Date: 13 JAN 2026		Signature:	
Transporter's Acknowledgment of Receipt of Waste Stamp: Ankleshwar, Bharuch, Gujarat.		Date: 13 JAN 2026		Signature: Tarif	
Receiver's Certification of Receipt of Hazardous Waste I, hereby declare that the said waste is received at the facility/unit for which I have valid authorization (under Rule-9 in case of recycling) for its disposal/ utilization. I also declare this information to be true failing which I will be held responsible for the consequences under HJOWM Rules, 2016 and amendments thereof. I hereby, accept/ reject the manifest.					
In Principal Approval Details : Accepted - 03/01/2026 2:05PM -					

Stamp:

Date:

Signature:

By scanning QR code, copy of transporter will be display. (All copy has same information)

Print by: 14937 @03/01/2026 F2FF3C52-2A02-4889-9DA3-897FE477-6A82
14:07:11

BEIL INFRASTRUCTURE LIMITED -- [14983]
(Hazardous Waste Manifest)

Manifest No: 3221272
Manifest Date: 22/01/2026

Copy 1

To be forwarded by the occupier to the State Pollution Control Board or Committee.

Sender's Details					
Sender Name	Asian Paints Ltd. - [14983]				
Address	2602, City : ANKLESHWAR Taluka :ANK District:ANK Pin no:393002				
Contact Details	9925270903, mailto:mankad@asianpaints.com	GPS Coordinates	Lat: ,Long:		
Guardian Detail					
Receiver's Details					
State	Gujarat	Type of Facility	Common TSDF		
Facility Details	BEIL INFRASTRUCTURE LIMITED - [14983]	Intermediate Facility			
Contact Details	8238040998, dalwadibda.beil.co.in	GPS Coordinates	Lat: 21.616265593533978, Long: 73.04892407902906		
Address	9701-16, 9801-28, 9901-28, 9601-04, 10001-10008, 11-28, 7924-27, --- 9401-9412, 9501-9506, 7905 E to H, GIDC, Ankleshwar City Ankleshwar Taluka, ANK District:ANK Pin no:393002				
Waste Details					
Waste Details	I-35-35.3-Chemical sludge from waste water treatment--				
Waste Intended for	COTSDF	Total Qty	9.790MT	Consistency	Solid
Transporter Details					
Name	PURVA ENTERPRISE	Contact Details	9428850037 purvaenterprise@gmail.com		
Address	78 Ganesh Park Residency Nr.Sardar Park, GIDC Ankleshwar				
Vehicle Details					
Vehicle no	GJ16W8843(IMEI No.868613060222727)		GPS Enabled	Yes	
Driver name	MANISH BHAI	Driver Contact No	8271456790	Type of Vehicle	Truck
Waste Transportation Details					
Vehicle Depart.	22/01/2026	Number of Drums	0	Leave Waste	9.790
Remarks	ETP sludge			No of bags	0
Sender's Declaration: (1) The above contents of hazardous/ other wastes consignment are fully and accurately described above by proper shipping name and are categorized, packed, marked and labeled, and are in all respects in proper conditions for its transport from aforementioned location to common facility or captive facility or actual user by way of road transportation in accordance with the applicable central as well as state government regulations. (2) I have obtained consent of common facilities/ carried out agreement with actual user for disposal/ actual use of hazardous waste having authorization under Rule 17. I do hereby verify that no part of manifest is false and nothing has been concealed. If any information sprouts to be false or concealed, I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof. Name and stamp of sender: _____ Date: <u>22/1/26</u> Signature: _____					
Transporter's Acknowledgement of Receipt of Hazardous Waste Stamp: <u>PURVA ENTERPRISE</u> Date: <u>22/1/26</u> Signature: <u>manish</u>					
Receiver's Declaration: I, hereby acknowledge and accept the receipt of Hazardous Waste at the facility/unit for which I have valid CCA (under Rule-9 in case of recycling) for its disposal/ utilization. I also declare this information to be true failing which I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof. I hereby, accept/ reject the manifest.					

Stamp: _____

Date: _____



Signature: _____

BEIL INFRASTRUCTURE LIMITED -- [14983]
(Hazardous Waste Manifest)

Manifest No: 3235144
Manifest Date: 03/02/2026

Copy1

To be forwarded by the occupier to the State Pollution Control Board or Committee.

Sender's Details					
Sender Name	Asian Paints Ltd. - [14937]				
Address	2602, City - ANKLESHWAR Taluka :ANK Distict:ANK Pin no:393002				
Contact Details	9925270903, malay.mankad@asianpaints.com	GPS Coordinates	Lat: ,Long:		
Guardian Detail	...				
Receiver's Details					
State	Gujarat	Type of Facility	Common TSDF		
Facility Details	BEIL INFRASTRUCTURE LIMITED - [14983]	Intremediat Facility			
Contact Details	8238040998, dalwadibdg@beil.co.in	GPS Coordinates	Lat: 21.616265593533978, Long: 73.04892407902906		
Address	9701-16, 9801-28,9901-28,9601-04,10001-10008,G-7&8,7924-27,--- 9401-9412,9501-9506,7905 E to H, GIDC, Ankleshwar City :Ankleshwar Taluka :ANK Distict:ANK Pin no:393002				
Waste Details					
Waste Details	I~35~35.3~Chemical sludge from waste water treatment~				
Waste Intended for	COTSDF	Total Qty	8.710MT ✓	Consistency	Solid
Transporter Details					
Name	PURVA ENTERPRISE	Contact Details	9428850037 Parthtransport07@gmail.com		
Address	29,swagatam Residency Andala,ankleshwar				
Vehicle Details					
Vehicle no	GJ17XX9080(IMEI No:863070048404452)		GPS Enabled	Yes	
Driver name	Mithunjay	Driver Contact No	8789047792	Type of Vehicle	Truck
Waste Transportation Details					
Vehicle Depart.	03 02/2026	Number of Drums	0	Loose Waste	8.710
Remarks	ETP sludge			No of bags	0
Sender's Declaration: (1) The above contents of hazardous/ other wastes consignment are fully and accurately described above by proper shipping name and are categorized, packed, marked and labeled, and are in all respects in proper conditions for its transport from aforementioned location to common facility or captive facility or actual user by way of road transportation in accordance with the applicable central as well as state government regulations. (2) I have obtained membership of common facilities/ carried out agreement with actual user for disposal actual use of hazardous waste having authorization under Rule-9. (3) I do hereby verify that no part of manifest is false and nothing has been concealed. If any information sprouts to be false or concealed, I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof.					
Name and stamp of sender:		Date: 03/02/26		Signature: 	
Transporter's Acknowledgement of Receipt of Waste Stamp: PURVA ENTERPRISE A-78, Ganesh Park Residency, Sardar Park, GIDC, Ankleshwar-393002					
Receiver's		Date: 03/02/26		Signature: 	
I, hereby declare that the said waste is received at the facility/unit for which I have valid CCA (under Rule-9 in case of recycling) for its disposal/ utilization. I also declare this information to be true failing which I will be held responsible for the consequences under HOWM Rules, 2016 and amendments thereof I hereby: accept/ reject the manifest.					

Stamp: _____

Date: _____

Signature: _____

Annexure – L

Hazardous waste coprocessing data

Haz waste disposal for the period of Oct'25 to Mar'26		
Month	Haz waste qty (in MT) disposed through coprocessing/Pre-processing	Coprocessing/Pre-processing disposal Site
Oct-25	3.28	BEIL INFRASTRUCTURE LIMITED, Ankleshwar
	22.57	J.K Cement Ltd, Mangrol, Rajasthan.
Nov-25	7.97	J.K Cement Ltd, Mangrol, Rajasthan.
Dec-25	7.25	J.K Cement Ltd, Mangrol, Rajasthan.
Jan-26	12.75	J.K Cement Ltd, Mangrol, Rajasthan.
Feb-26	26.78	J.K Cement Ltd, Mangrol, Rajasthan.
Mar-26	25.26	J.K Cement Ltd, Mangrol, Rajasthan.
Total	105.86	

Annexure – M

MSIHC data

MSIHC data

Sr. No	Category	Criterion	Threshold Quantities (Tons)		Stock oh hand
			Lower	Higher	
1	Flammable Liquids	60 < F.P < 90	5000	50000	45.925
2	Highly Flammable liquids which remains liquid under pressure	23 < F.P < = 60	25	200	NA
3	Highly Flammable Liquids	23 < F.P < = 60	2500	20000	2091.104
4	Very highly flammable liquids	FP < = 23 , B.P > 35	1500	10000	560.081
5	Extremely flammable liquids	FP < = 23, B.P < 35	1000	5000	NA
6	Flammable Gases	LEL<=13% at 20Degree C and STP 101.3 Kpa	15	200	<80 kg
7	Toluene di-isocyanate (TDI)	-	10	100	0.0
8	Ammonia	-	60	600	17.668
9	Highly Flammable liquids as Per Schedule 3 Part 2 (GFR)	-	1000	5000	<78 kg
9	Acetylene (ethyne)	-	5	NA	<2kg
10	Hydrogen	-	2	50	45.925

Annexure – N

List of fire extinguishers

BLOCK WISE LOCATION	NUMBER OF FIRE EXTINGUISHER
ADMIN	29
BARREL YARD	13
BSR	37
CANTEEN	5
CAR	2
COLONY	32
EB	44
EBG	6
ECC	1
ENGG STORE	1
ETP	4
FG	18
FIRE STORE	614
GATE-1	2
GATE-2	4
GATE-3	1
GATE-4	2
INCINERATOR	4
MTF	6
NG Station	1
OHC	1
PARKING	2
PEL	4
PUMP HOUSE	14
QA	15
RB	49
RBG	2
RENNER	37
REST ROOM	3
RMG	18
RMG-1	40
RMPM	2
ROMEE	4
SATF	2
SBG	10
SCRAP YARD	2
SPB	151
STF	10
UTILITY	42
WBG	6
WPB	47
Total	1287

Annexure – O

Half Yearly Medical Report



Medical Examination Form

Demographic Information

EMP ID	:	p00401916	SR NO:	130
Name	:	RANJEETKUMAR S PRASAD	Date:	23/12/2025
Age/ Sex	:	37 YRS./MALE		
Department	:	NEIRS		
ID MARK	:	WARTS ON FOREHEAD		

VITALS CHECKUP

Blood Pressure: -	120/80 mm Hg	HEIGHT (IN CM): -	160
PULSE: -	74 min Regular	Weight (IN KGS): -	51.9
BMI VALUE: -	20.3 kg/m ²	BMI STATUS: -	NORMAL

HISTORY

Current Health Complaints	NO
Past History	NO
Family History	NO
Allergies	NO
Ongoing Medication	NO
Nasal Discharge & Nail Examination	N.A

EYE TEST

1. VISION

A. NEAR VISION		B. DISTANCE VISION	
RIGHT EYE: -	N\8	RIGHT EYE: -	6\6
LEFT EYE: -	N\8	LEFT EYE: -	6\6

2. COLOR VISION

RIGHT EYE: -	WNL
LEFT EYE: -	WNL

3. TORCH LIGHT EXAMINATION

RIGHT EYE: -	NAD
LEFT EYE: -	NAD
Peripheral Vision Test: -	N.A
REMARKS: -	-

DOCTOR'S SIGNATURE

Revival Diagnostics
Dr. Rahul D Pujara
MBBS, CIH
Medical Officer-Regd. No. C 50107

Laboratory Test Result are Subject to technical limitation and should be clinically correlate for final diagnosis

4th Floor, Aqua Corridor, Hazira Road, Adajan Pal, Surat-395009.

0261 2747788, 9825947712 revivaldiagnostics.surat@gmail.com www.revivaldiagnostics.com

This medical report is not intended for medico-legal purposes.

REVIVAL DIAGNOSTICS



Name	RANJEETKUMAR S PRASAD	Age/Gender	37Yrs/Male
Reg No.	AS130/03	Receipt No	22585
Referred By	ASIAN PAINTS LIMITED	City	Ankleshwar
Collection Type	CAMP	Collection DateTime	24-Dec-2025 09:53 AM

CBC - 241225279 Released at 24-Dec-2025 11:16 AM

Parameter	Result	Biological Ref.Range	Method
-Haemoglobin	16.4 gm/dL	(13.5 - 18 gm/dL)	Auto
-RBC Count	5.50 mill/cumm	(4.6 - 6.2 mill/cumm)	Auto
-Total WBC Count	6000 /cumm	(4000 - 10000 /cumm)	Auto
-Platelet Count	2.48 lakh/cumm	(1.5 - 4.5 lakh/cumm)	Auto
Blood Indices			
-HCT	51.8 %	(40 - 55 %)	Auto
-MCV	94.1 fl	H (80 - 92 fl)	Auto
-MCH	29.8 pg	(27 - 31 pg)	Auto
-MCHC	31.6 gm/dL	L (32 - 36 gm/dL)	Auto
-RDW	13.6 %	(11 - 15 %)	Auto
Diff WBC Count			
-Polymorphs	57 %	(40 - 80 %)	Microscopically
-Lymphocytes	38 %	(20 - 40 %)	Microscopically
-Eosinophils	03 %	(1 - 6 %)	Microscopically
-Monocytes	02 %	(2 - 7 %)	Microscopically
-Basophils	00 %	(0 - 1 %)	Microscopically
-PLATELET ON SMEAR	Adequate		Microscopically
-MALARIAL PARASITES	Malarial Parasites Not Detected		Microscopically

[Test performed on Fully Automated Hematology Analyzer ERBA H-360]

Dr. Shivangi Gandhi
M.B.B.S, M.D (Pathology)

Laboratory Test Result are Subject to technical limitation and should be clinically correlate for final diagnosis

4th Floor, Aqua Corridor, Hazira Road, Adajan Pal, Surat-395009.

☎ 0261 2747788, 9825947712 ✉ revivaldiagnostics.surat@gmail.com 🌐 www.revivaldiagnostics.com

This medical report is not intended for medico-legal purposes.

REVIVAL

DIAGNOSTICS



Name	RANJEETKUMAR S PRASAD	Age/Gender	37Yrs/Male
Reg No.	AS130/03	Receipt No	22585
Referred By	ASIAN PAINTS LIMITED	City	Ankleshwar
Collection Type	CAMP	Collection DateTime	24-Dec-2025 09:53 AM

Urine Routine & Micro Examination - 241225329 Released at 24-Dec-2025 10:19 AM

Parameter	Result	Biological Ref.Range	Method
Physical Examination			
-Quantity	30		Manual
-Colour	Pale Yellow	Pale Yellow	Manual
-Appearance	Clear	Clear	Manual
-Reaction (pH)	Acidic		Dipstick
-Specific Gravity	1.025		Dipstick
Chemical Examination			
-Proteins.	Absent		Dipstick
-Sugar	Absent		Dipstick
-Acetone.	Absent		Dipstick
-Bile Salts	Absent	Absent	Dipstick
-Bile Pigments	Absent	Absent	Dipstick
-Occult Blood Test (OBT).	Negative		Dipstick
Microscopic Examination			
-Pus Cells	1-2/hpf.		Microscopically
-Red Blood Cells	Absent		Microscopically
-Epithelial Cells	Occasional		Microscopically
-Bacteria.	Absent		Microscopically
-Casts	Absent	Absent	Microscopic Examination
-Crystals	Absent	Absent	Microscopically
-Others	NIL	Absent	Microscopic Examination

Sg

Dr. Shivangi Gandhi
M.B.B.S, M.D (Pathology)

Laboratory Test Result are Subject to technical limitation and should be clinically correlate for final diagnosis

4th Floor, Aqua Corridor, Hazira Road, Adajan Pal, Surat-395009.

0261 2747788, 9825947712 revivaldiagnostics.surat@gmail.com www.revivaldiagnostics.com
This medical report is not intended for medico-legal purposes.

Annexure – P

Six monthly noise report



POLLUCON LABORATORIES PVT. LTD.

TEST CERTIFICATE FOR NOISE MONITORING

QF/7.8/37-EX

Page: 1 of 1

Customer's Name and Address :

M/s. ASIAN PAINTS LIMITED
2602, GIDC, INDUSTRIAL ESTATE,
ANKLESHWAR – 393 002
TEL NO. (02646) 678 000

Test Report No. : PL/AP /25/0023

Issue Date : 06/02/2025

Customer's Ref. : PO. No. 0015385354 Dated:
31/03/2024

Date of Sampling : 10/01/2025
Test Method : IS 9989
Sampling Location : As per table
Sampling By : Pollucon Laboratories Pvt. Ltd.

RESULT TABLE

SR. NO.	SAMPLING LOCATION	OBSERVATION	
		Day Time dB(A)	Night Time dB(A)
1	Near Gate No. 1	65.1	52.1
2	Near Admin Building	64.7	47.8
3	Near Canteen	60.3	42.8
4	Near ETP	71.8	60.9
5	Near Distribution Center	64.2	58.7
6	Incinerator Area	58.9	50.8
7	Contractor Workshop	65.3	56.9
8	Near Gate No.3	60.7	51.4
9	Barrel Cleaning Area	61.5	52.6
GPCB LIMIT#		75 dB(A)	70 dB(A)

#As per consent order No AWH-111615 & 111616 Issue Date: 18/02/2021 Up to 26/12/2025.

Day time shall mean from 6.00 a.m. to 10.00 p.m.

Night time shall mean from 10.00 p.m. to 6.00 a.m.

Ravi Jariwala
Sr. Environmental Scientist

Dr. Arun Bajpai
Lab Manager(Q)

Note: This report is subject to terms & conditions mentioned overleaf.

● Recognized by MoEF, New Delhi under Section 12 of Environmental Protection Act-1986 ● GPCB approved ● ISO 14001:2004 ● CEISYS 12001:2007 ● ISO 9001:2005 ● Includes II auditor

"Pollucon House", Plot No.5/6, Opp.Balaji Industrial Society, Old Shantinath Silk Mill Lane, Near Gaytri Farsan Mart,
Navjivan Circle,Udhana Magdalla Road, Surat-395007, Gujarat, India.

Phone : 0261-2635750, 0261-2635751, 0261-2635775, 07016605174, WEB: www.polluconlab.com, E. mail: pollucon@gmail.com, info@polluconlab.com

Annexure – Q

Solar energy generation data

Solar Energy Generation Data

Month	Solar power harvested within factory (in KWH)
Oct-25	101771
Nov-25	105050
Dec-25	77909
Jan-26	62603
Feb-26	95078
Mar-26	136258
Total	578669

Annexure – R

Scan of EC advertisement in newspaper

in zoo

y of Baroda state

baug is the biggest and gardens of Vadodara. The cs here have been around Gaekwadi rule. Officials said the decades no blackbucks n or taken in exchange from s. Sources added that due to irths and deaths of the ks, their population had nearly stable over the

had killed deers 8 ago

anipuri Thamin deer were in the zoo when canines heir enclosure about eight k. Officials at the zoo said that ent was similar to the one that d on Friday. The deers were ed by the dogs, but died due to panic had spread in the e were they were kept. TMN

ks. "These could not have be- Only three or four of them en by the dogs," the source enclosure had 11 blackbucks three exist inside it now.

Yield of seeds from Guj is better

► continued from P1

Sowing activity in Guja- rat may not have reac- hed its full pace, but pur- chases of cumin seeds for sowing purposes has already increased 10% in the state this Rabi season. This is mainly because farmers and traders from Rajasthan are coming to Unjha to purchase seeds as the yield of the seeds from Gujarat is much better.

Traditionally, Gujarat and Rajasthan account for most of the cumin produc- tion in India. In fact, diver- gent views are prevailing about the highest cumin pro- ducing state. Federation of Indian Spice Stakeholders (FISS) had placed Rajasthan on top position in 2017-18 with production of 37.83 lakh bags of 55 kg each (around 2.08 lakh tonnes) as compared to Gujarat's 31.40 lakh bags (1.72 lakh tonnes). However, Spices Board of India under Union ministry of commerce and industry pegged Gujarat's production at 2.91 lakh tonnes and that of Rajasthan at 2.06 lakh tonnes in 2017-18.

Six-year-old girl raped; hunt on for accused

Rajkot: In a heinous incident, a six-year-old girl was raped by an unidentified person who fled after the crime in Matawadi local- ity of Botad on Thursday.

The accused approached the girl, who was playing with other kids, and lured her to accompa- ny him with the promise of get- ting her kites. One of the boys playing with the girl also went along with them. The accused took the girl and the boy, aged four years, to a compound, where

he asked the boy to go away and raped the girl. When the girl re- turned home, she was bleeding.

Her parents, both labourers, took her first to Sonavala Hospi- tal in Botad and then to Sir T Hos- pital in Bhavnagar, where doc- tors confirmed that she was ra- ped. The girl's father then lod- ged a police complaint.

Police have registered the ca- se of rape and under sections of Protection of Children from Sex- ual Offences (POCSO) Act. TMN

INDEXtb

INDUSTRIAL EXTENSION BUREAU
(A Government of Gujarat Organization)

ONLINE SHORT TENDER IS INVITED FOR SUPPLY, INSTALLATIONS, TESTING & COMMISSIONING (SITC) OF RF BASED SIS (SIMULTANEOUS INTERPRETATION SYSTEM) EQUIPEMENT AT MAHATMA MANDIR CONVENTION CENTER, GANDHINAGAR, GUJARAT.

Interested agencies may download the tender document from our website www.indextb.com and <https://indextb.nprocure.com> during 30.11.2018 to 10.12.2018.

Managing Director
Industrial Extension Bureau,
18/2, Udyog Bhavan,
Gandhinagar 382 010.
Phone: 079-23250492/93

INDEXtb
INDUSTRIAL EXTENSION BUREAU
(A GOVT OF GUJARAT ORGANIZATION)

ds life due to ll rises to 17

the case on the complaint of Vasa- ni's cousin brother Ashok Vasani. On November 28, Mansukh Koli (44), a farmer from Sangoi village of Sayla taluka in Surendranagar hanged himself to death from the wood meant for pulley in the well of his farm.

The prevailing agrarian crisis is taking toll of the farmers in Sau- rashtra.

Farmers suicides have been mainly from Jamnagar, Porban- dar, Devbhumi Dwarka, Amreli and Surendranagar districts. Most of these farmers were groundnut and cotton growers. This year the average rain in most districts of Saurashtra was about 50% less and that too not uniform intervals as required for the crop.

The restriction on irrigation water supply by the government had added to the woes of the farmers facing crop failure. The state government has so far declared 51 talukas as scarcity-hit after consi- dering the figures of rainfall.



at hospital in wife and two

goods train it police in- police sta- y two child- ghter — and go is 25 km e registered

M/s. ION EXCHANGE (INDIA) LTD.

Plot No.5811-12-13, GIDC Industrial Estate, Ankleshwar, Bharuch.

ENVIRONMENTAL CLEARANCE

It is hereby informed that the State level Environment Impact Assessment Authority, Gandhinagar, Gujarat has accorded the Environment Clearance for setting up of expansion in Synthetic Organic Chemicals manufacturing by M/s. ION EXCHANGE (INDIA) LTD. at Plot No.5811-12-13, GIDC Industrial Estate, Ankleshwar, Bharuch. - vide File no: SEIAA/GUJ/EC/5(h)/1255/2018 dated 26th November, 2018, A copy of the clearance letter is placed at office of Gujarat Pollution Control Board (Ankleshwar & Gandhinagar) and may also be seen at website of State level Environment Impact Assessment Authority, Gandhinagar, Gujarat at <http://seiaa.gujarat.gov.in/>



Asian Paints Limited

Asian Paints House, 6A Shantinagar, Santacruz (East), Mumbai - 400 055

State Level Environmental Impact Assessment Authority - Gujarat, has accorded Environmental Clearance to Asian Paints Limited, Ankleshwar vide Letter - SEIAA / GUJ / EC / 5(h) / 597 / 2018. The Environmental Clearance is to expand its production capacity upto 3,00,000 Kilolitres per annum of Paints and 85,000 Tons per annum of Resins & Emulsions. The Environmental Clearance is for the operations at Plot no. 2602 to 2607, 2609 to 2614, 2701/A, 2701/B, 2702 and 2703 at GIDC Ankleshwar, Gujarat. Abovementioned Environmental Clearance is available with the GPCB and can be accessed from the website of the authority at <http://seiaa.gujarat.gov.in/597%2013062018.pdf>

INDIAN RING ROAD BRANCH, SURAT, IDBI Bank Limited, Ground Floor,

કરજી-શિનોર અને વડોદરા તાલુકાનાં થોડા ગામડાઓ નાં કરજી વિધાન સભામાં વિસ્તારમાં રસ્તાની કામગીરી છેલ્લા એકાદ વર્ષથી સ્થગિત થઈ ગઈ હોવાનું જણાય છે. ત્યારે ગ્રામ્ય વિસ્તારના કાર્યકરોની રજુઆતો ને પગલે પૂર્વ કારારસભ્યે કરજી તાલુકાનાં નવા નોન પ્લાન રસ્તાઓ મંજૂર કરાવ્યા છે. જેમાં સાયર (ઓડવાળા ટેકરા)થી સગડોળ બસસ્ટેન્ડ સુધી એપ્રોચ રોડ કંડારીથી

વનોરા રોડ, વાવટથી ગણપતનુ રોડ, અટાલીથી કોલીયાદ રોડ અને હાંડીદથી સુરવાડા રોડની બાકી રહેતી લંબાઈ જ્યારે શિનોર તાલુકા માં છાણભોઈથી આનંદી રોડ, આનંદીથી પુનિયાદ રોડ, બીધલીથી નંદેરિયા રોડ, દરીયા પુરા એપ્રોચ દામનગર પિસાઈ રોડ અને ઝાંઝડ-જંબેશ્વર રોડ નોન પ્લાન તથા ૭ વર્ષ જુના રસ્તાઓને પુનઃ સમતલ કરવાની કામગીરીમાં ગીરીમાં

શિનોર તાલુકાનાં સાધલી-દિવેર-રણપુરા રોડ અને સાધલી તેરસા રોડ આ બન્ને રોડને રિસેકેસિંગ તથા જરૂરી મજબુતી કરણ પાછળ રૂ. ૧૬૬ લાખ મંજૂર કરાતાં ગ્રામજનો માં આનંદની લાગણી વ્યાપી છે. જ્યારે વડોદરા તાલુકાનાં સરા ગામની ભાગોળ થઈ કાશીપુરા પોર ને જોડતો રોડ નોન પ્લાન કાચો મંજૂર થયો હોવા જાણવા મળે છે. ઉલ્લેખનીય છે કે તાલુકામાં વિધાન સભાની બેન્ડ ભાજપે ગુમાવ્યા બાદ વિકાસની હરણફાળને બ્રેક લાગી હતી.

પર પોલીસ અને વન વિભાગના ચોકીયા મહારાષ્ટ્રના અસામાજિક તત્વો બે રોકટોક મહારાષ્ટ્રના અસામાજિક બેઠકક ગુજરાતમાં ધુ દેડિયાપાડાથી ૩૫ કિમી દુર ડુમખલ આવેલું છે. તેની નજીકથી દેવ નદી પસાર થાય છે. દેવ નદીનો પૂલ ગુજરાત અને મહારાષ્ટ્ર રાજ્યને જોડે છે. અહીં અગાઉ વન ખાતાની ચોકી હતી, જેને હાલ તાળા વાગી ગયાં છે. પોલીસ ચોકી ક્યારેય નહોતી. આથી મહારાષ્ટ્રના અસામાજિક તત્વોને ગુજરાતમાં ઘુસવાની મોકળાશ મળી રહે છે. વળી, આ જ માર્ગે મહારાષ્ટ્રમાંથી દારૂ ઘુસાડવાનું મોટું ષડયંત્ર કાર્યરત છે. અહીંથી ગુજરાતમાં કેરેટર દારૂ પહોંચાડઈ રહ્યો છે. સ્થાનિક હરીશો આ માર્ગે દારૂ

અંકલેશ્વર ખાતે વ્યક્તિગત લોન અંગે સેમિનાર સંપન્ન

ભરૂચ, તા. ૩૦ વડાપ્રધાને સુષ્મ, લઘુ અને મધ્યમ ઉદ્યોગોને પ્રોત્સાહન માટેના પોર્ટલનું તા. ૨૪ નવેમ્બરે રાષ્ટ્રીયકક્ષાએ ઉદઘાટન કર્યું હતું. પોર્ટલની વિસ્તૃત જાણકારી આપવા માટે અંકલેશ્વર જીઆઈડીસી ખાતે નીતિ આયોગના સેક્રેટરીના અધ્યક્ષસ્થાને કાર્યક્રમ રમાયો હતો. તેમણે કહ્યું હતું કે, લઘુ અને મધ્યમ ઉદ્યોગને શીઘ્રતાથી અને સરળતાથી રૂ. ૧ કરોડ સુધીની લોન માત્ર ૫૯ મિનિટમાં ઓનલાઈન મેળવી શકાય તે માટે આ પોર્ટલનું લોકાર્પણ થયું છે. આ પોર્ટલ દ્વારા લઘુ અને મધ્યમ

ઉદ્યોગો માટે કાનૂનનું પાલન સરળતાથી થશે. તેમજ લઘુ અને મધ્યમ ઉદ્યોગોના કર્મચારીઓને સુરક્ષાનો લાભ મળી શકશે. ઉદ્યોગોના વિકાસ વક્રી દેશના અર્થતંત્રને વેગ મળશે તેમ જ જાણી વિવિધ સબસીડીની પણ માહિતી આપી હતી. તેમણે સુષ્મ, લઘુ અને મધ્યમ ઉદ્યોગોના પ્રોત્સાહન માટે શરૂ કરવામાં આવેલ પોર્ટલની વિસ્તૃત માહિતી આપતા ટ્રેડ્સ પોર્ટલ, મુદ્રા યોજના, સ્ટેન્ડપ ઈન્ડિયા યોજના, સી.જી.ટી.એમ.એસ.ઈ. વિશે પણ માહિતી પુરી પાડી હતી. આ પ્રસંગે જે ઉદ્યોગકારોની લોન મંજૂર થઈ તેઓને મહાનુભાવોના હસ્તે મંજૂરી પત્રો અપાયો હતો.

મહારાષ્ટ્રના રાજ્યપાલ આજે સરદાર પ્રતિમાની મુલાકાતે

રાજ્યપાલ મહારાષ્ટ્રના રાજ્યપાલ સરદાર પ્રતિમાની મુલાકાતે આવી રહ્યા છે. તેઓ તેમના પત્ની સાથે તા. ૧લીને શનિવારે સવારે ૧૦.૩૦ કલાકે કેવડીમાકોળોની ખાતે હેલીકોપ્ટર દ્વારા આવી પહોંચશે. ત્યારબાદ તેઓ સરદાર પ્રતિમાની મુલાકાત લેશે. રાજ્યપાલ બપોરે ૧-૪૦ કલાકે કેવડીયા હેલીપેડ ખાતેથી હેલીકોપ્ટર દ્વારા વડોદરા એરપોર્ટ જવા રવાના થશે.

ભરૂચ જિલ્લા સમિતિની ૧૫મીએ બેઠક

ભરૂચ જિલ્લા હરિયાદ અને સંકલન સમિતિની બેઠક તા. ૧૫મીથી સવારે ૧૧ કલાકે જિલ્લા કલેક્ટરના અધ્યક્ષને મળશે.

દેડિયાપાડાના મંદિરમાં સંગીતમય રામકથા

દેડિયાપાડા રામકથાનું અમૃતપાન કરી રહ્યા છે. અયોધ્યાનિવાસી મર્યાદા પુરષોત્તમ ભગવાન રામચંદ્રજીનું જીવન ચરિત્ર, રામાયણનું મહત્વ અને આ રામચંદ્રજી સીતાજી, લક્ષ્મણ અને અન્ય પાત્રોનું મહત્વ સમજાવી રહ્યા છે. શ્રોતાઓ આ કથા સાંભળીને મંત્રમુગ્ધ થઈ જાય છે.

સ્પર્ધાત્મક પરીક્ષાના જિલ્લા કલેક્ટર

ભરૂચ, તા. ૩૦ જી. આંબેડકર એજ્યુકેશન એન્ડ વેલ્ફેર ટ્રસ્ટ તથા માછિયા સાર્વજનિક ગ્રેરીટેબલ ટ્રસ્ટ દ્વારા આયોજીત સ્પર્ધાત્મક પરીક્ષાની તાલીમ મેળવતા છાત્રોની જલ્લા કલેક્ટરે મુલાકાત લઈ તાલીમધર્મીઓનો ઉત્સાહ વધાર્યો હતો. આંબેડકર ભવન ખાતે પોલીસ,

નવોદય વિદ્યાલયમાં ધો. ૬ની પ્રવેશ પરીક્ષા

પાદરા સાધીના જવાહર નવોદય વિદ્યાલયમાં ધો. છમાં પ્રવેશ મેળવવા ઓનલાઈન કાર્યવાહી શરૂ થઈ છે. તે માટેની વેબસાઈટ પર હવે ફોર્મ ભરવાની છેલ્લી તારીખ ૧૫ ડિસેમ્બર રાખવામાં આવી છે. ધો. છ માટે પસંદગી પરીક્ષા તા. ૬-૪-૧૯ના રોજ છે. તે માટે કેટલીક શરતો છે કે, વિદ્યાર્થી ધોરણ પાંચમાં વડોદરા અને છોટાઉદેપુર જિલ્લાની સરકારી શાળામાં અભ્યાસ કરેલો હોવો જોઈએ, તેની જન્મતારીખ તા. ૧-૫-૦૬ થી ૩૦-૪-૯૦ વચ્ચેની હોવી જોઈએ.

ઈલાવ ગામના દિવ્યાંગ યુવાનની નેશનલ હેન્ડીકેપ્ડ ક્રિકેટ ટીમમાં પસંદગી

ભરૂચ, તા. ૩૦ હાંસોટ તાલુકાના ઈલાવ ગામે રહેતા અને ગરીબ ખેડૂત પરિવારના ૨૦ વર્ષીય યુવાન કેવલ અજયભાઈ પટેલ બાળપણથી દિવ્યાંગ છે અને તેને પગના બોડ છે. જે કે અડગ મનના માનવીને હિમાલય પણ નડતો નથી એમ કેવલ પટેલે તેના ક્રિકેટ રમવાના ચોખ્ખા પરિશ્રમમાં ફેરવી એક તક હાસલ કરી છે. કેવલ પટેલની ઓલ ઈન્ડિયા

ક્રિકેટ એસોસીએશન ફોર ધ ફિઝિકલી ચેલેન્જડની ક્રિકેટ ટીમમાં પસંદગી થઈ છે અને તે મુંબઈ કાતે રમાનાર આફઘાનીસ્તાન સામેની ૩ ટી ૨૦ અને ૨ વન ડે મેચમાં ભરત તરફથી રમશે. કેવલ પટેલ રાઈટ હેન્ડ બેટ્સમેન છે. અને તેનો ફેવરેટ ક્રિકેટર મહેન્દ્રસિંઘ ધોની છે. ગરીબ પરિવારના યુવાનની નેશનલ ક્રિકેટ ટીમમાં પસંદગી થતા ઈલાવ ગામમાં ખુશીની માહોલ જોવા મળી રહ્યો છે.

એશિયન પેઇન્ટ્સ લિમિટેડ
asianpaints
એશિયન પેઇન્ટ્સ હાઉસ, 6A શાંતીનગર, સાંતાક્રુઝ (ઇસ્ટ), મુંબઈ-૪૦૦ ૦૫૫.
રાજ્યભરત પર્યાવરણ અસર આકારણી સત્તા, ગાંધીનગર ગુજરાતએ એશિયન પેઇન્ટ્સ લિમિટેડ અંકલેશ્વર પ્લાંટને પર્યાવરણ ક્લિયરન્સ, લેટર SEIAA/GUJ/EC/5(H)/597/2018 દ્વારા મંજૂર કરેલ છે. પર્યાવરણ મંજૂરી પેઇન્ટ્સની ઉત્પાદન સમતા ૩,૦૦,૦૦૦ કિલોલિટર/વર્ષ સુધી અને ટેડીન અને ઈમલ્શનની ઉત્પાદન સમતા ૮૫,૦૦૦ ટન/વર્ષ સુધી વધારવા માટે આપવામાં આવી છે. પર્યાવરણ મંજૂરી પ્લોટ નં. ૨૬૦૨ થી ૨૬૦૭, ૨૬૦૮ થી ૨૬૧૪, ૨૬૦૧/એ, ૨૬૦૧/બી, ૨૬૦૨ અને ૨૬૦૩ જી.આઇ.ડી.સી. અંકલેશ્વરનાં ઓપેશન માટે આપી છે. ઉપરોક્ત પર્યાવરણ મંજૂરી GPCB થાકે ઉપલબ્ધ છે અને આ માહિતી ઓથોરીટીની વેબસાઈટ <http://seiaa.gujarat.gov.in/597%2013062018.pdf> પર પણ નોંધ શકાય છે.

મે. આયન એકસચેન્જ (ઇન્ડિયા) લિ
પ્લોટ નંબર ૫૮૧૧-૧૨-૧૩, જીઆઈડીસી ઓથોરિટી એસ્ટેટ, અંકલેશ્વર, ભરૂચ.
પર્યાવરણીય મંજૂરી
સાધી જાણ કરવામાં આવે છે કે રાજ્ય સ્ટોરે પર્યાવરણ અસર આકારણી સત્તા, ગાંધીનગર, ગુજરાતએ મે. આયન એકસચેન્જ (ઇન્ડિયા) લિ., પ્લોટ નંબર: ૫૮૧૧-૧૨-૧૩, જીઆઈડીસી ઓથોરિટી એસ્ટેટ, અંકલેશ્વર, ભરૂચ. ને કુત્રિમ ઓર્ગેનિક કેમિકલ્સ ઉત્પાદનમાં વિસ્તરણ માટે પર્યાવરણ મંજૂરી ફાઇલ નં. SEIAA/GUJ/EC/5(H)/255/2018 તારીખ ૨૬ નવેમ્બર, ૨૦૧૮ ના રોજ માન્યતા આપી દીધી છે. મંજૂરી પત્રની નકલ ગુજરાત પ્રદૂષણ નિયંત્રણ બોર્ડ (અંકલેશ્વર અને ગાંધીનગર) ની કચેરી પર મૂકવામાં આવે છે અને રાજ્ય સ્ટોરે પર્યાવરણ અસર આકારણી સત્તા, ગાંધીનગર, ગુજરાતની વેબસાઈટ <http://seiaa.gujarat.gov.in/> પર પણ નોંધ શકાયો.